

## Fig. 190

### Off-Set Eye Socket

**Size:**  $\frac{3}{8}$ "

**Material:** Galvanized steel

**Service:** Attachment to structure to connect threaded hanger rod.

**Approvals:** UL and ULC Listed, and FM Approved.

**Installation:**

- Thread rod completely into hanger. Secure rod by tightening jam nut against bottom of hanger.
- Secure hanger to structural member with recommended fasteners.

**Features:**

- Pre-formed threads for easy rod assembly.
- Off-set angle provides unlimited vertical adjustment.

**Ordering:** Specify rod size, figure number and name.

Description	Pipe Sizes	Rod Size	Max. Load
Off-Set Eye Socket Hanger	$\frac{3}{4}$ " - 4"	3/8-16 UNC	250 lbs.

FASTENERS		
Description	Quantity	Pipe Size
#14 x 2" Wood Screw	2	* $\frac{3}{4}$ " - 2"
$\frac{1}{2}$ " x 3" Lag Screw	*1	$\frac{3}{4}$ " - 4"
3/8-16 UNC Jam Nut	1	$\frac{3}{4}$ " - 4"

\* Lag screw not required for  $\frac{3}{4}$ " - 2" pipe sizes using the alternate option of (2) wood screws.


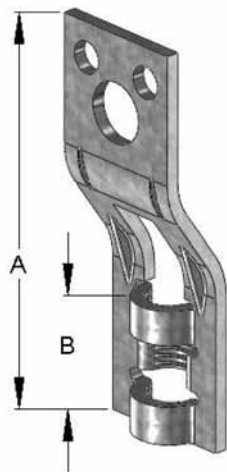


FIG. 190: DIMENSIONS (IN)	
A	B
3.38	1.10

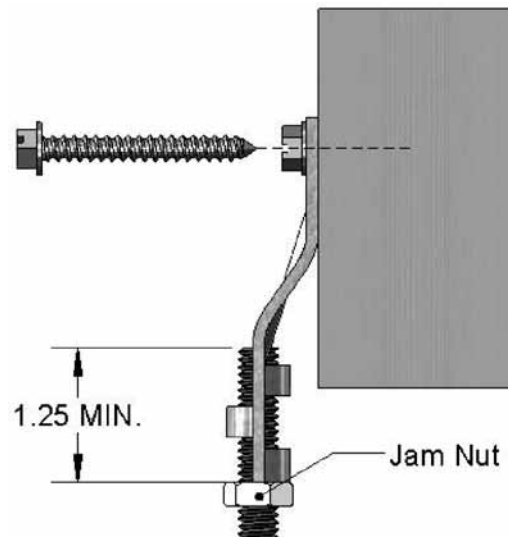

**Notes:**

1. For fire protection installation follow the requirements of National Fire Protection Association, NFPA-13 and local codes.
2. To assure proper performance, installer is responsible for:
  - a. Structural integrity of attachment member to safely handle load requirements.
  - b. Securely tightening jam nut on the hanger rod.