




TRICON STEEL-CON PLUS PIPE SYSTEM



**Class "A" System For Applications Up To 450° F
Below And Above Ground**

- Condensate
- Fuel Oil
- Heating Hot Water
- High Temp. Hot Water
- Process Piping
- Steam

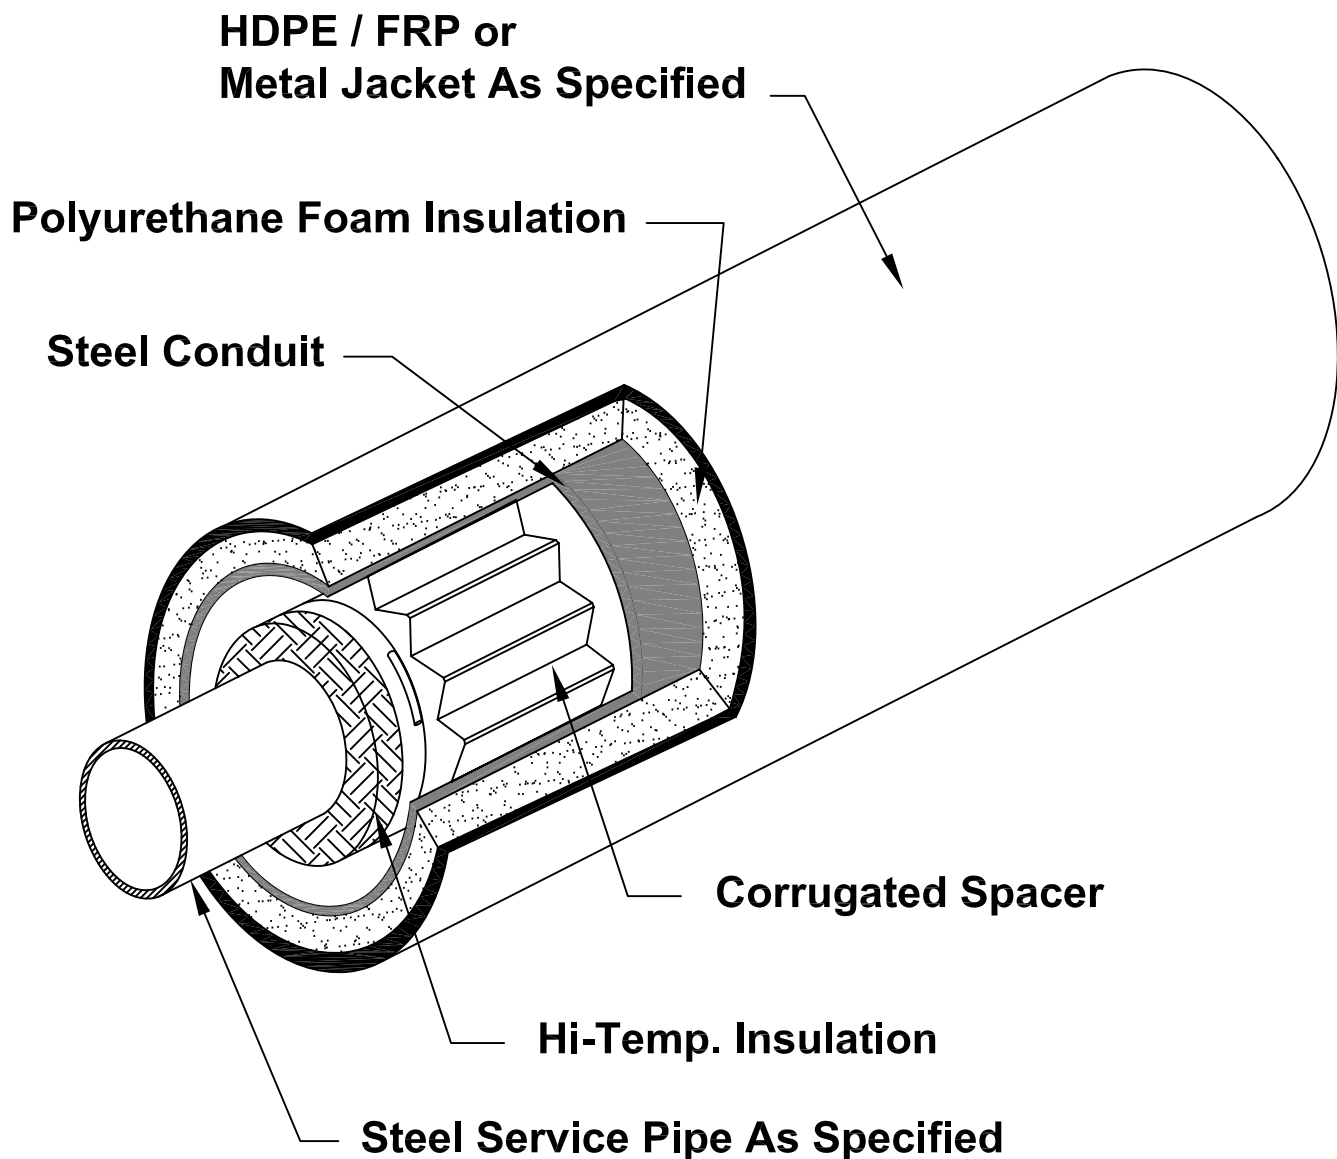

TRICON
Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032
Tel: 315.697.8787 Fax: 315.697.8788

Pipe Size	Insulation Thickness (IN)*	Steel Conduit O.D.	Outer Insulation (IN)*	HDPE Jacket O.D. (IN)	System Temperature
1"	1"	6.63"	1"	10.00"	Based on a minimum 3'-6" burial depth. 353° operating temperature, 50°F ground temperature and soil conductivity of 15 BTU-IN/HR-F ² -°F and mineral wool insulation
2"	1"	6.63"	1½"	10.00"	
3"	1½"	8.63"	1½"	12.43"	
4"	1½"	10.75"	1½"	14.06"	
5"	1½"	10.75"	1½"	14.06"	
6"	1½"	12.75"	1½"	15.87"	
8"	2"	16.00"	1½"	19.80"	
10"	2"	18.00"	1½"	22.17"	
12"	2"	20.00"	1½"	24.00"	

Service Pipe:

Carbon steel service pipe shall be standard weight A53 ERW or A106 seamless beveled for welding. Condensate return piping shall be Schedule 80. All joints for pipe 2 ½" and larger in size shall be butt-welded. Sizes 2" and smaller shall be socket welded. Straight lengths of piping will be supplied with 6" of piping exposed at each end for field joint fabrication. Where possible, piping lengths shall be supplied in 40 Ft. random lengths.

Insulation: (Inner Layer)*

Service pipe insulation shall be fiberglass, mineral wool, calcium silicate or cellular glass. The insulation will be held in place by aluminum bands on 18-inch centers. The insulation shall be applied to a thickness as specified on the contract drawings.

Service Pipe Supports:

The service pipe within the inner-conduit shall be supported at not more than 10 feet intervals. The supports shall be designed to allow for continuous airflow and draining of the conduit system. The insulated service pipe shall not bear directly on the steel support and shall be insulated through out.

Steel Conduit:

The outer conduit shall be a smooth wall, spiral welded or electric resistance welded steel pipe conforming to ASTM Specification A-139. The conduit shall be of thickness as listed below.

Conduit Size	Conduit Thickness
6" – 26"	10 Gauge
28" – 36"	06 Gauge
38" – 42"	04 Gauge

Insulation: (Outer Layer)*

The outer conduit insulation shall be polyurethane foam with a minimum 1-inch thickness. The polyurethane foam shall have a minimum density of 2.0, and a closed cell content of 90% to 95% per ASTM D-2856, and shall have a "K" factor of .14 per ASTM C-177 @ 75° F.

Exterior Casing:**

The exterior casing shall be seamless, extruded High Density Polyethylene (H.D.P.E.) ASTM D-1248, with the following physical properties:
 ASTM D-3350...Resin Type III, Grade P34
 ASTM D-638...Ultimate Elongation 850%
 ASTM D-638...Tensile Yield Strength 3300 psi
 ASTM D-790...Tangent Flexural Modules 175,000 psi
No polyethylene tape casings will be allowed.

Field Joint Closures:

Conduit field joint closures shall consist of the specified inner insulation, a cylindrical 10-gauge sleeve having one (1) horizontal split, insulation outer layer of polyurethane foam and a heat shrinkable sleeve with rockshield.

Sub-Assemblies:

Fittings, end seals and anchors shall be factory fabricated and insulated to prevent the ingress of moisture into the piping system. All sub-assemblies shall be designed and factory fabricated to allow for complete draining, drying and testing of the conduit system. All fittings larger than 2" will be made with long radius weld fittings and shall be the same wall thickness as the service piping.

Expansion Loops and Elbows:

Expansion loops and elbows shall be factory manufactured in the same manner as the straight lengths of piping. Loops and elbows shall be sized and designed to permit thermal movement of the service pipe without damage to the insulation.

Tricon Piping Systems, Inc.
P.O. Box 361
Canastota, NY 13032

Tel: 315-697-8787
Fax: 315-697-8788
www.triconpiping.com

Installation:

No Piping shall be installed in standing water. Trenches shall be maintained dry until final field closure is complete. The installing contractor shall handle the piping system in accordance with the directions furnished by the manufacturer and as approved by the architect and engineer. The service piping shall be hydrostatically tested to 1-1/2 times the operating pressure, or as specified in the contract documents. The inner conduit shall be air tested at 15 psig. The test shall be maintained for a minimum time of 1 hour. **EXERCISE DUE CARE IN INSTALLING AND TESTING THE PIPING SYSTEM**

Backfill:

A 4-inch layer of sand or fine gravel, less than 1/2" in diameter, shall be placed and tamped in the trench to provide uniform bedding for the **Steel-Con Plus** system. Once the system is in place, the trenches shall be carefully backfilled with similar material and hand tamped in 6" layers until a minimum of 12" above the top of the preinsulated pipe has been achieved. The remainder of the backfill shall be void of rocks, frozen earth and foreign material. The trench shall be compacted to comply with H-20 Highway loading.

Accessories:

- Heat Tracing
- Leak Detection

System Options:


- Contact your Tricon representative for available sizes and system options.

* Insulation thickness will vary depending on the type of insulation specified and the operating temperature.


** Optional non-metallic casings for below grade offered include, Filament Wound FRP.

Tricon Piping Systems, Inc.
P.O. Box 361
Canastota, NY 13032

Tel: 315-697-8787
Fax: 315-697-8788
www.triconpiping.com

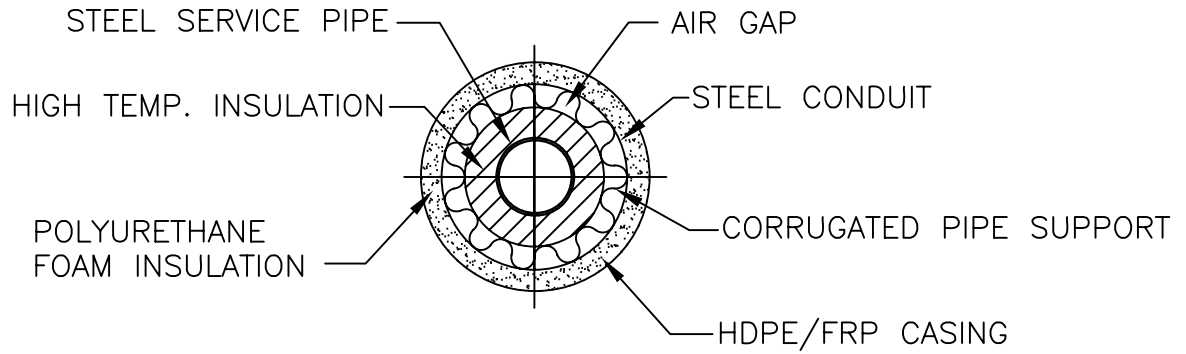

END VIEW
NOT TO SCALE

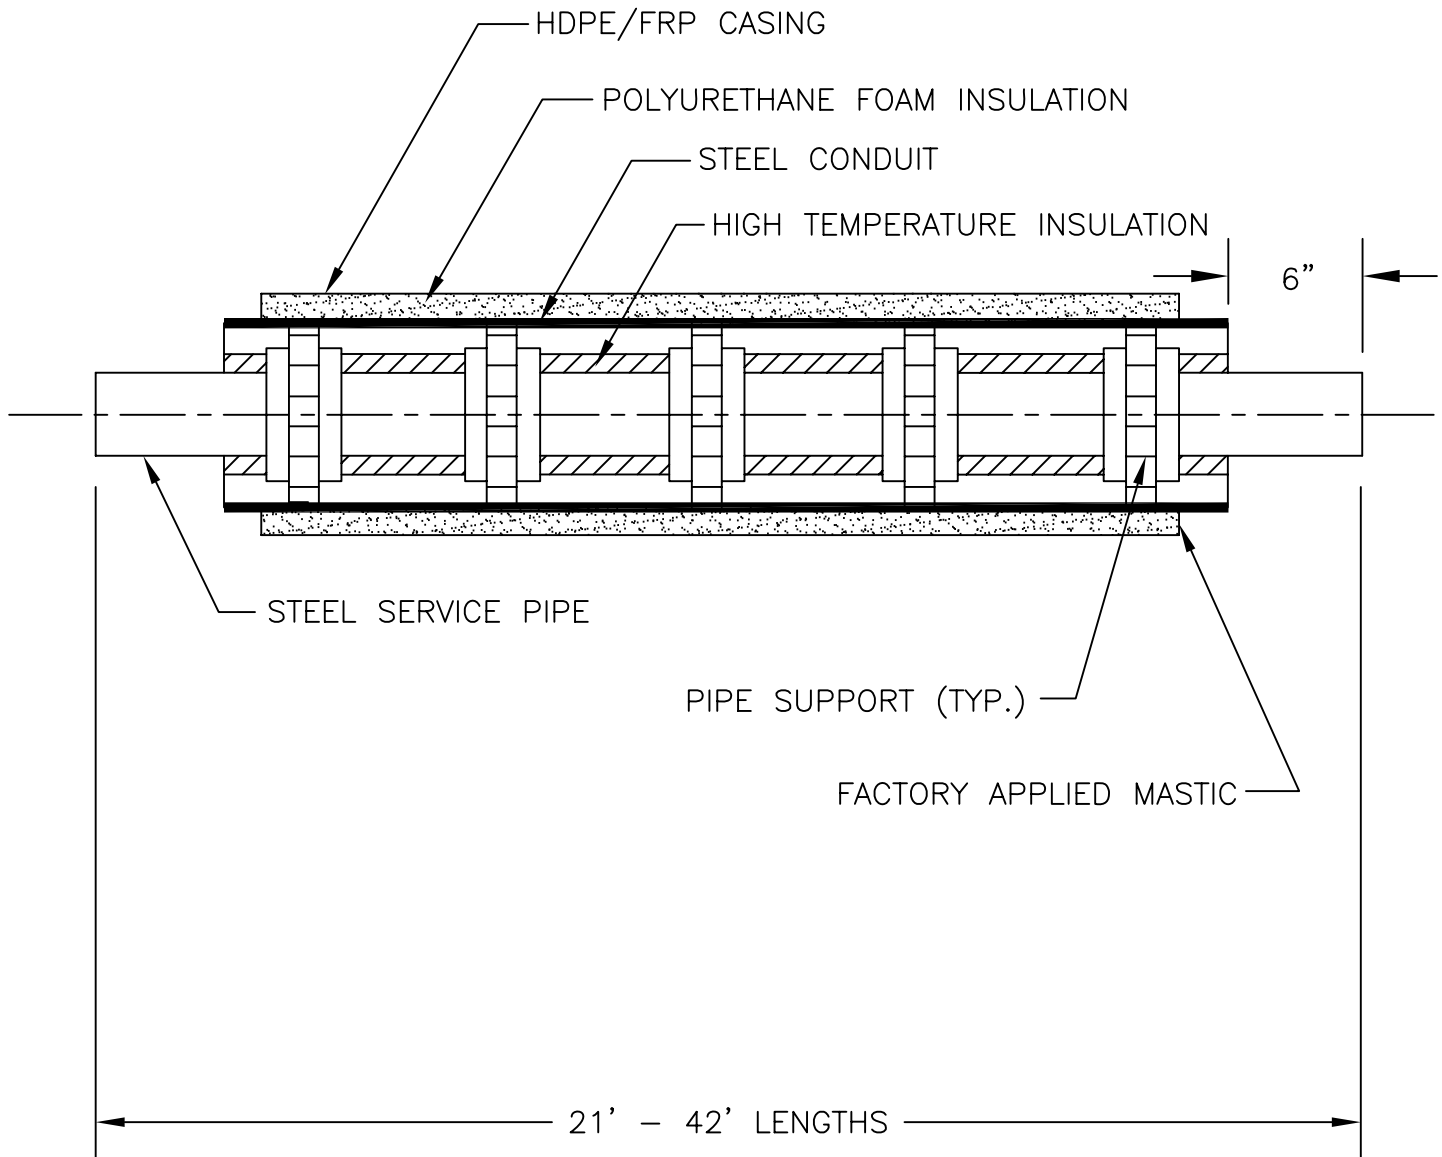

STEEL-CON PLUS STRAIGHT LENGTH DETAIL

TRICON STEEL CON PLUS

Date: 03/09/06

Dwg. No.: SCP-1

Rev.:




TRICON


Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

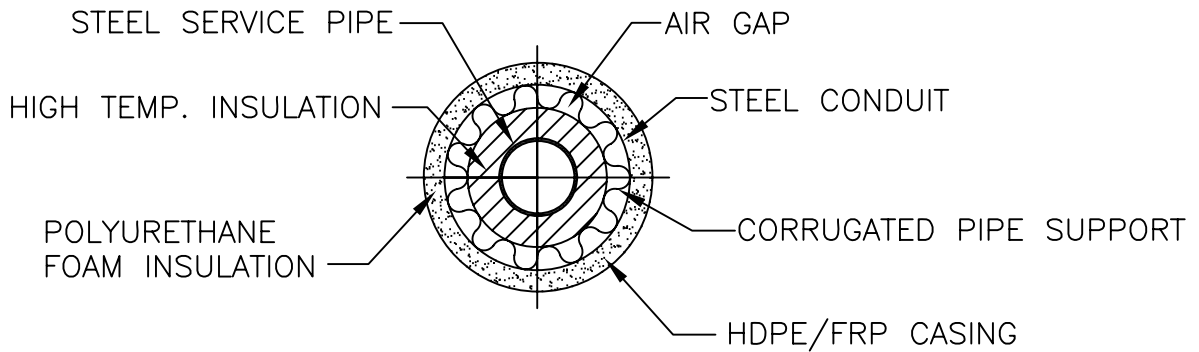

END VIEW
NOT TO SCALE

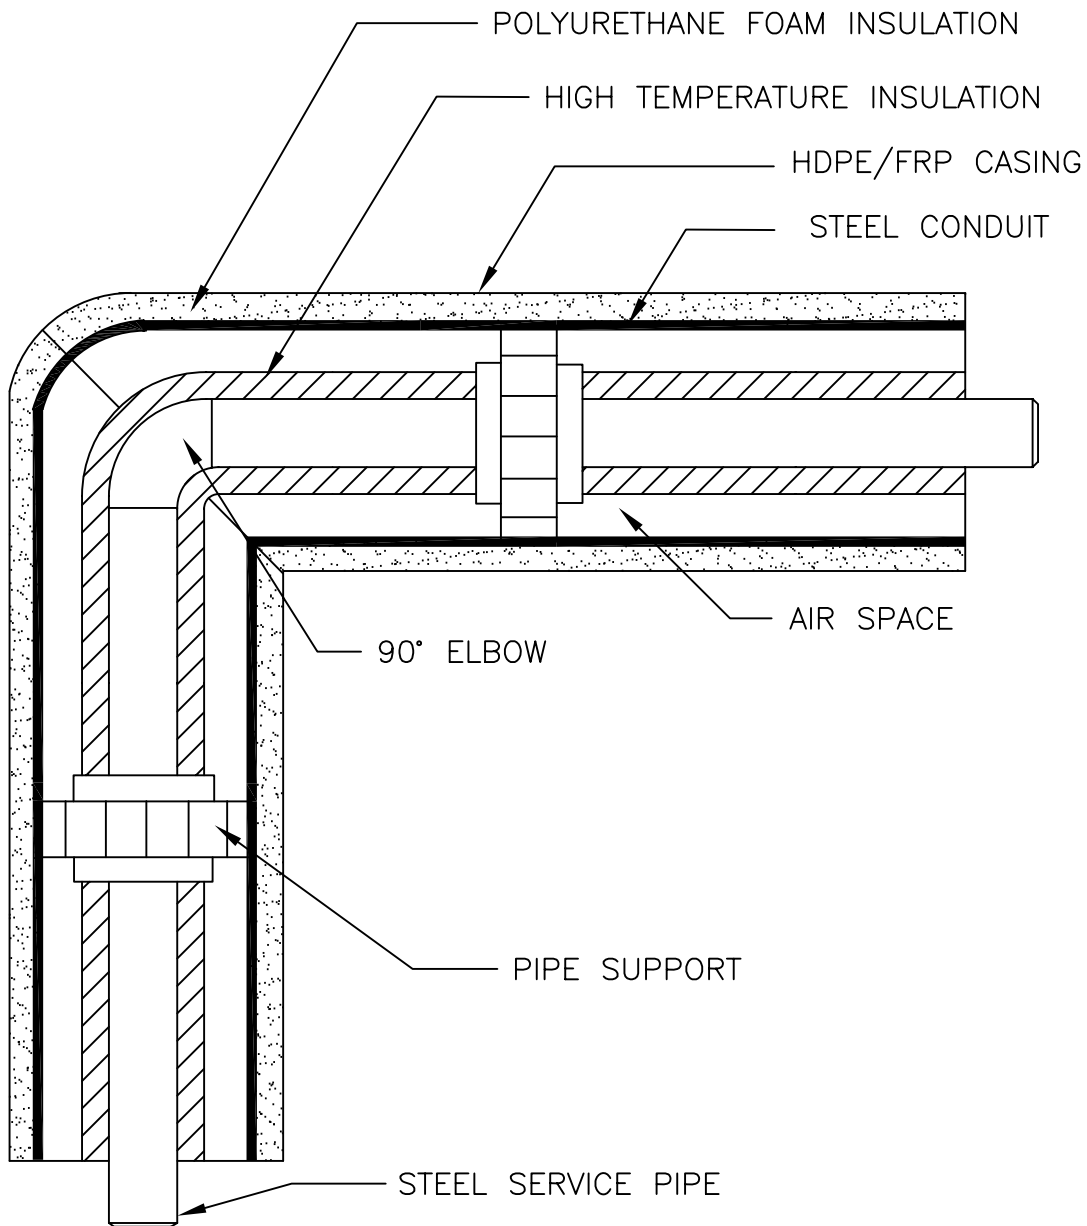

STEEL-CON PLUS 90° ELBOW DETAIL



TRICON STEEL CON PLUS

Date: 03/09/06 Dwg. No.: SCP-2
Rev.:



TRICON
Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032
Tel: 315.697.8787 Fax: 315.697.8788

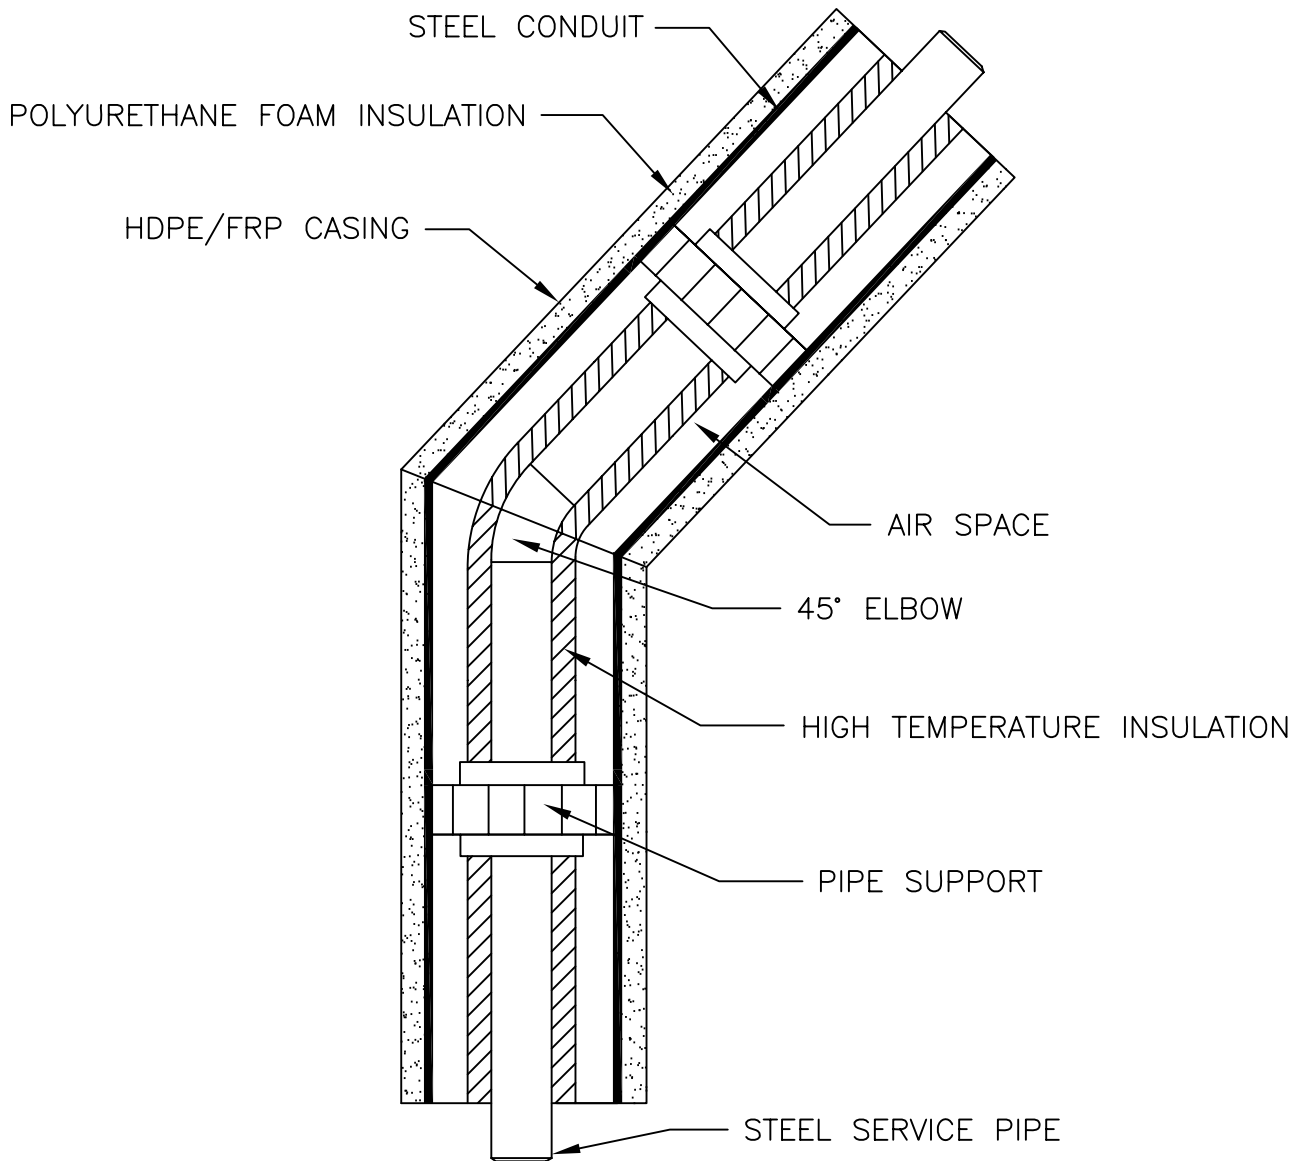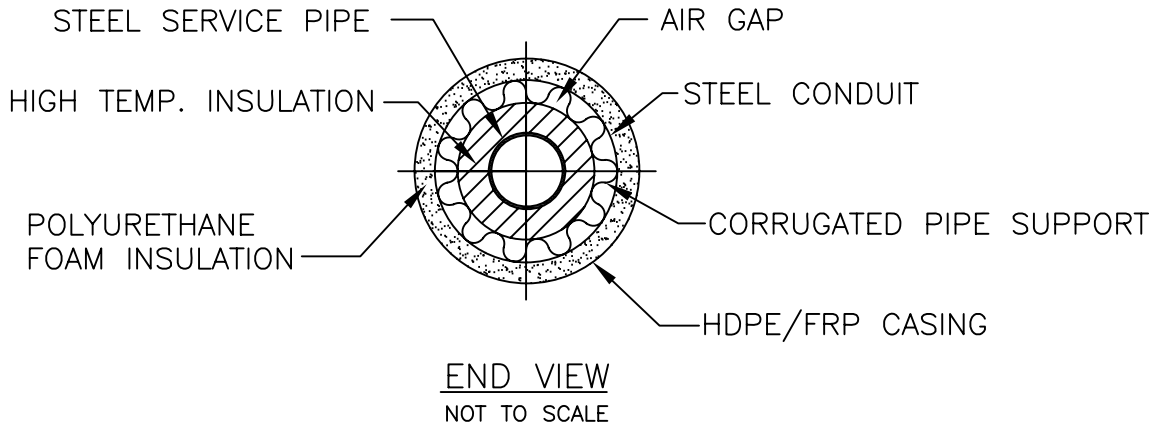

STEEL-CON PLUS 45° ELBOW DETAIL

TRICON STEEL-CON PLUS

Date: 03/09/06

Dwg. No.:SCP-3

Rev.:





TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

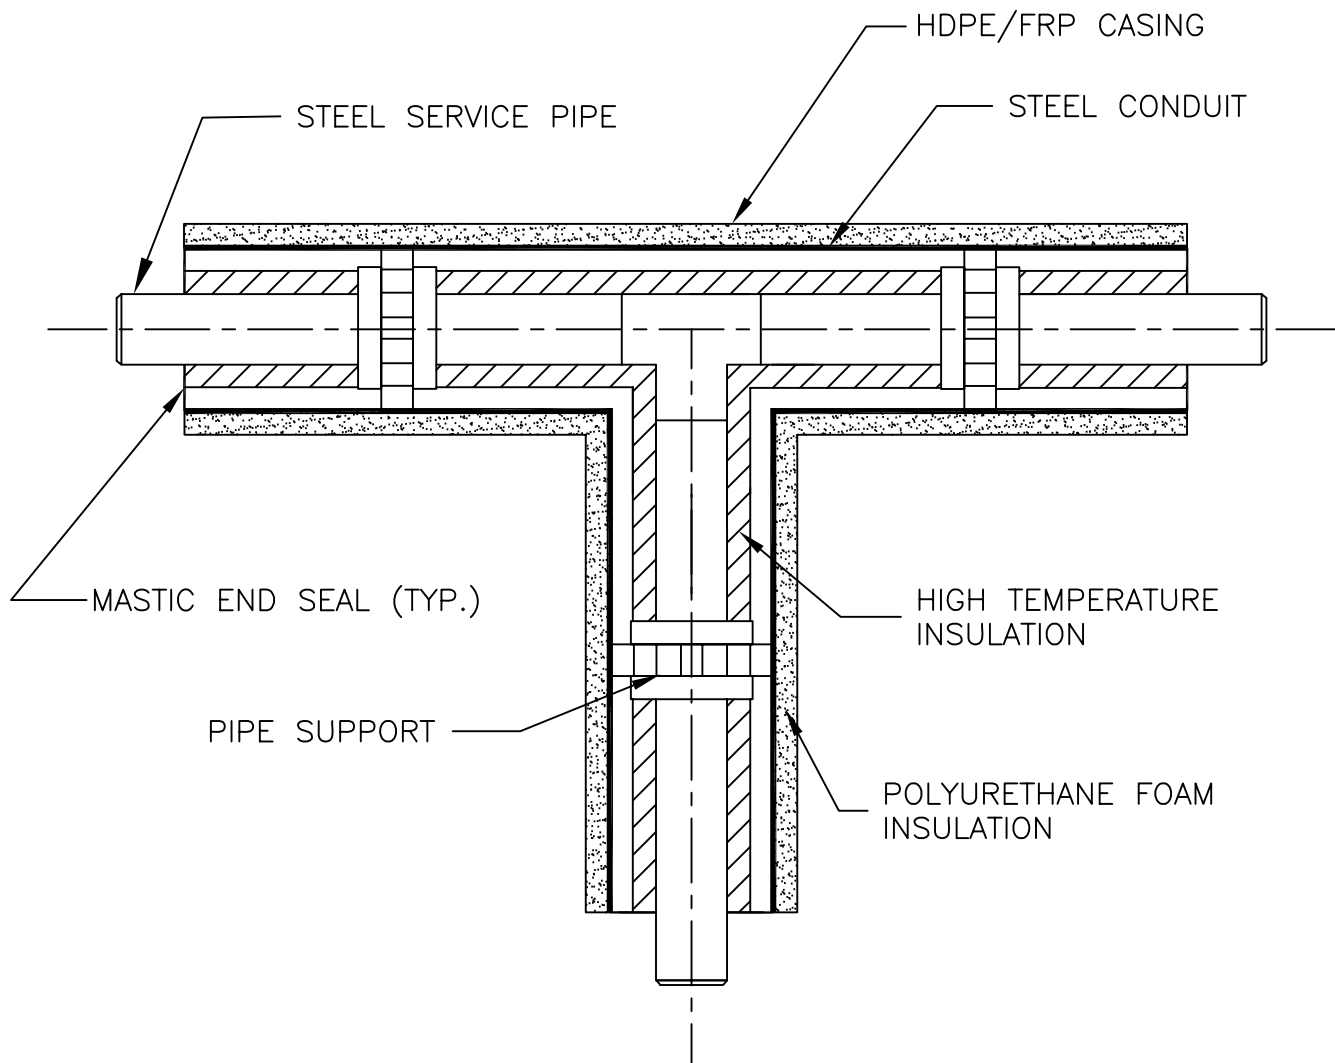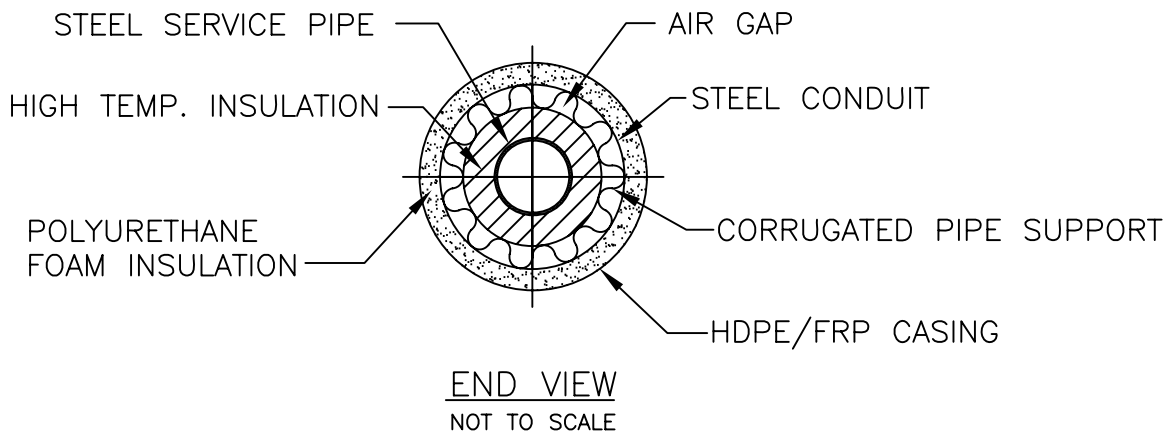

STEEL-CON PLUS TEE DETAIL



TRICON

Piping Systems, Inc.®



P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

TRICON STEEL-CON PLUS

Date: 03/09/06 Dwg. No.: SCP-4

Rev.:

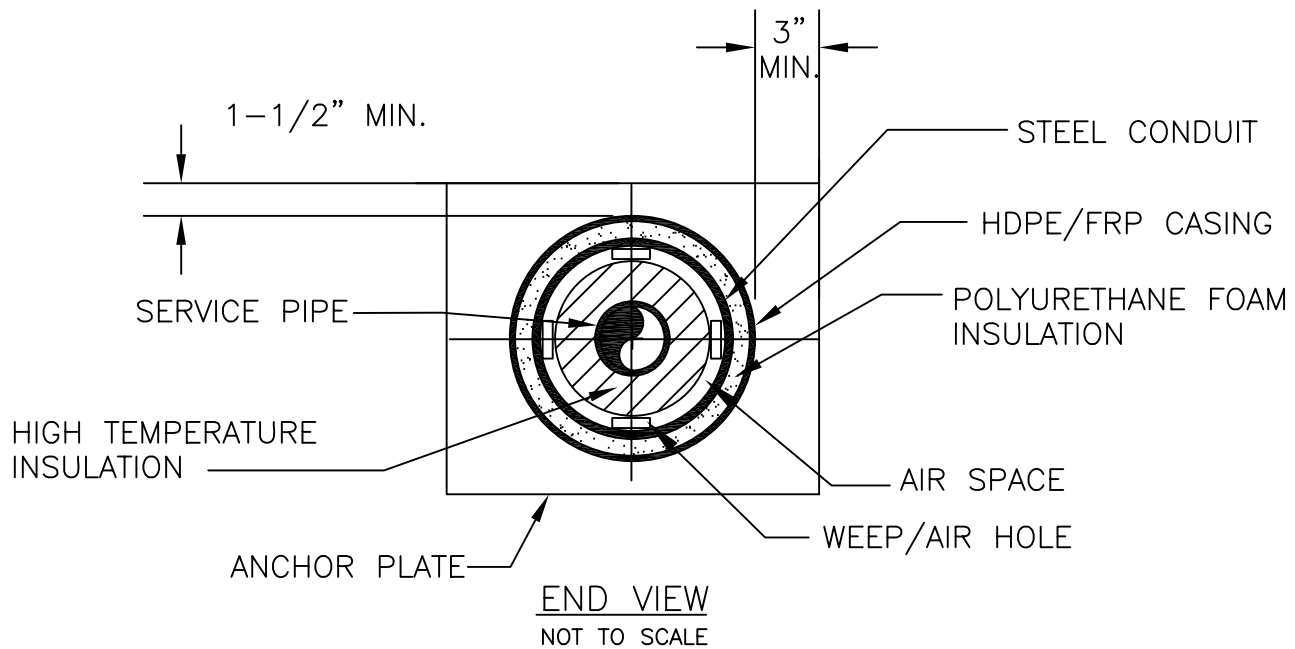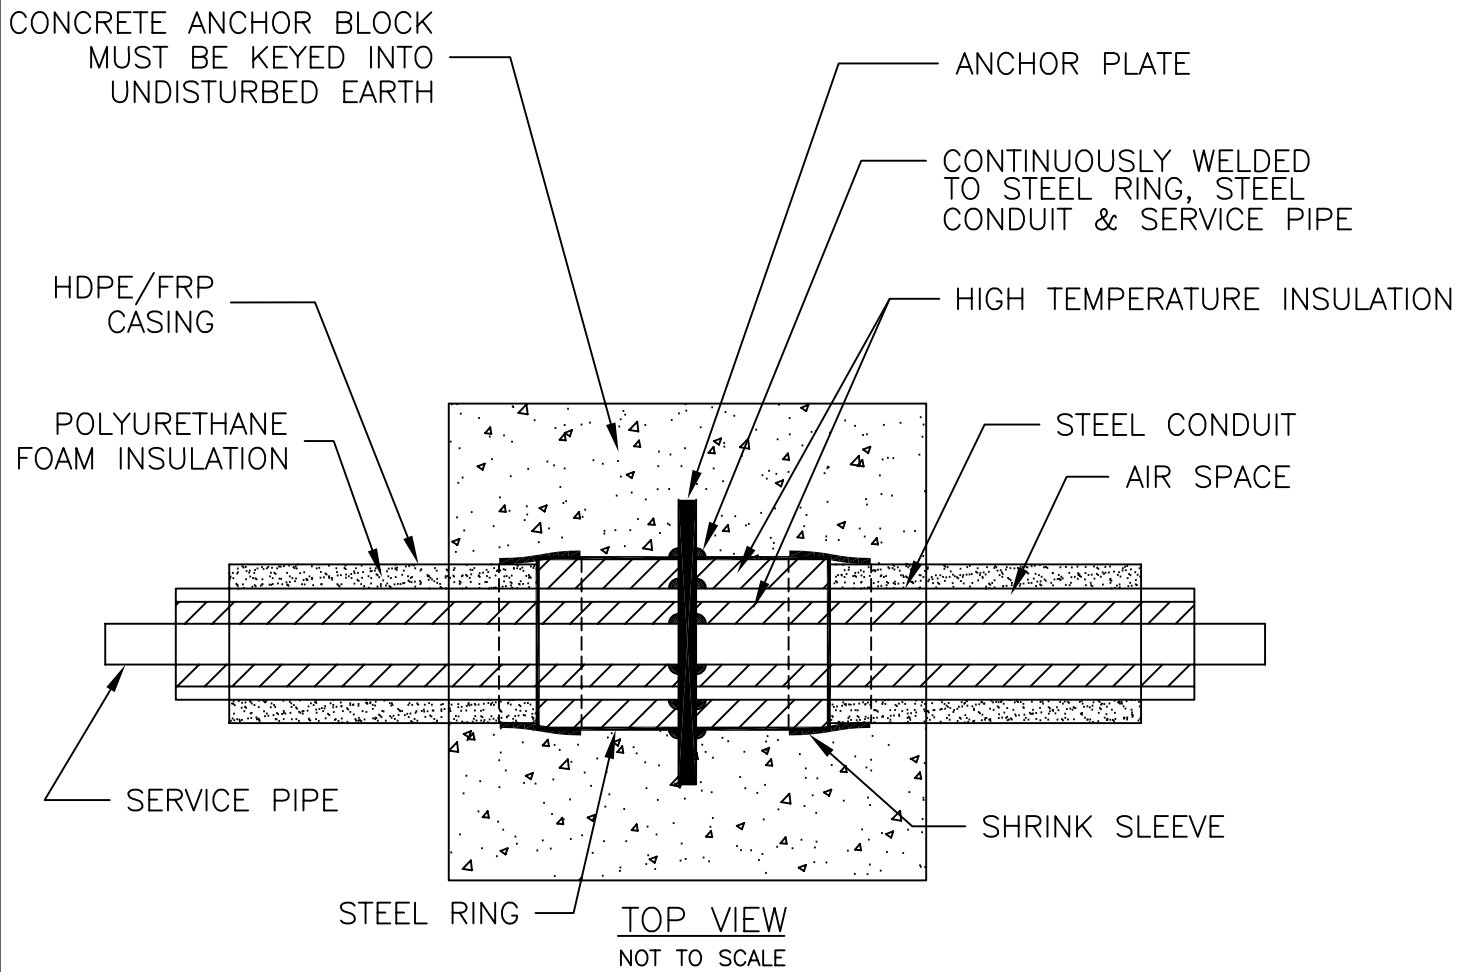

NOTE: CONCRETE ANCHOR BLOCK MUST BE KEYED INTO UNDISTURBED EARTH.

STEEL-CON PLUS ANCHOR DETAIL

TRICON STEEL CON PLUS

Date: 03/09/06 Dwg. No.: SCP-5

Rev.:




TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

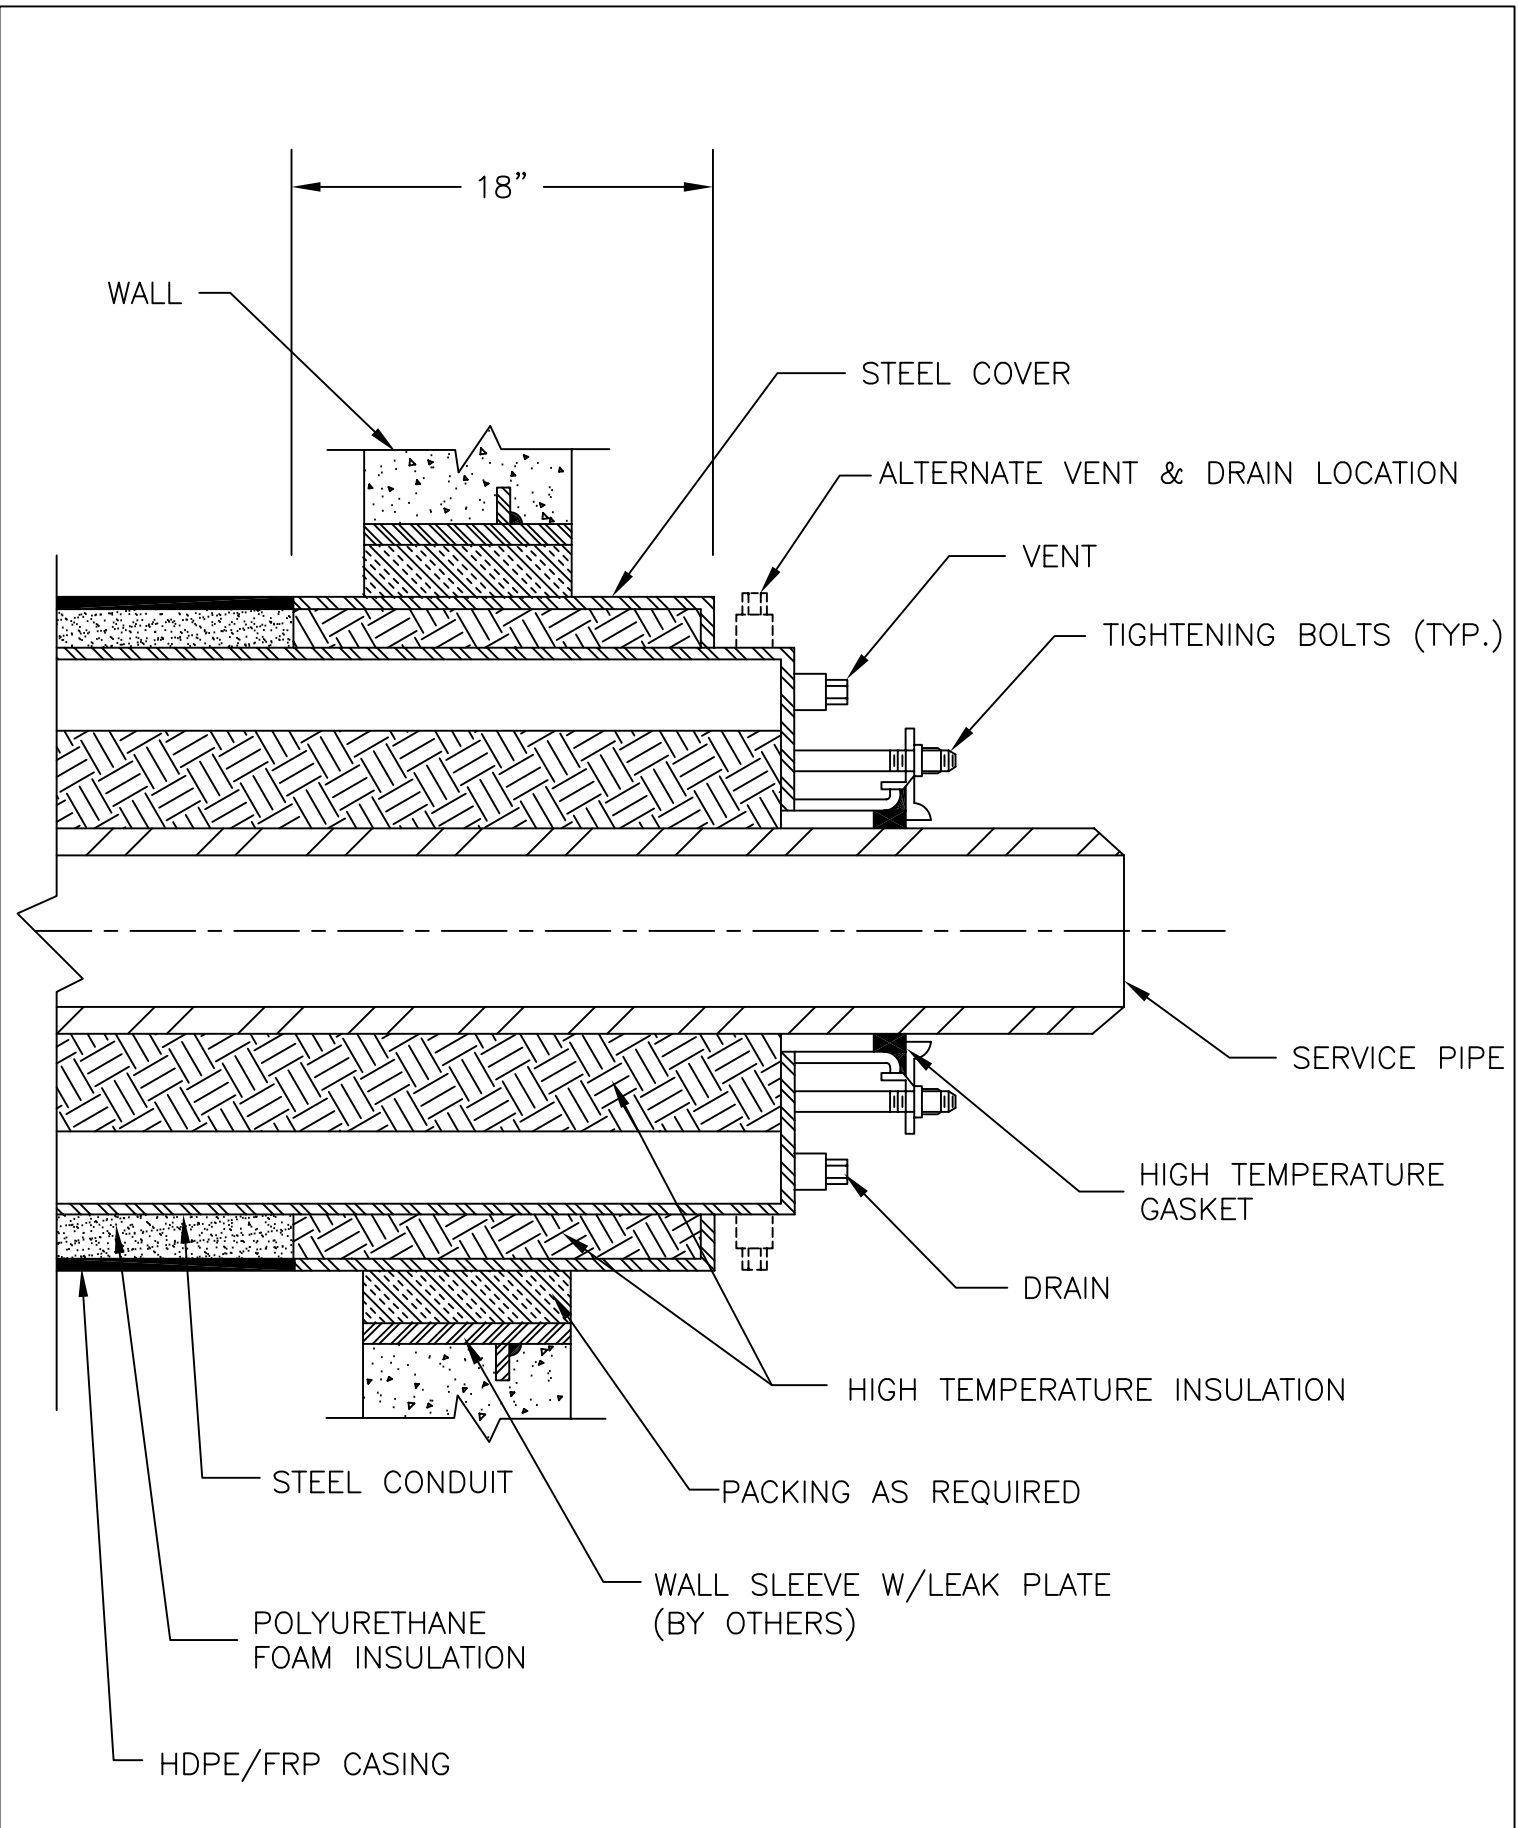

STEEL-CON PLUS GLAND END DETAIL

TRICON STEEL CON PLUS

Date: 03/09/06 Dwg. No.: SCP-6

Rev.:




TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

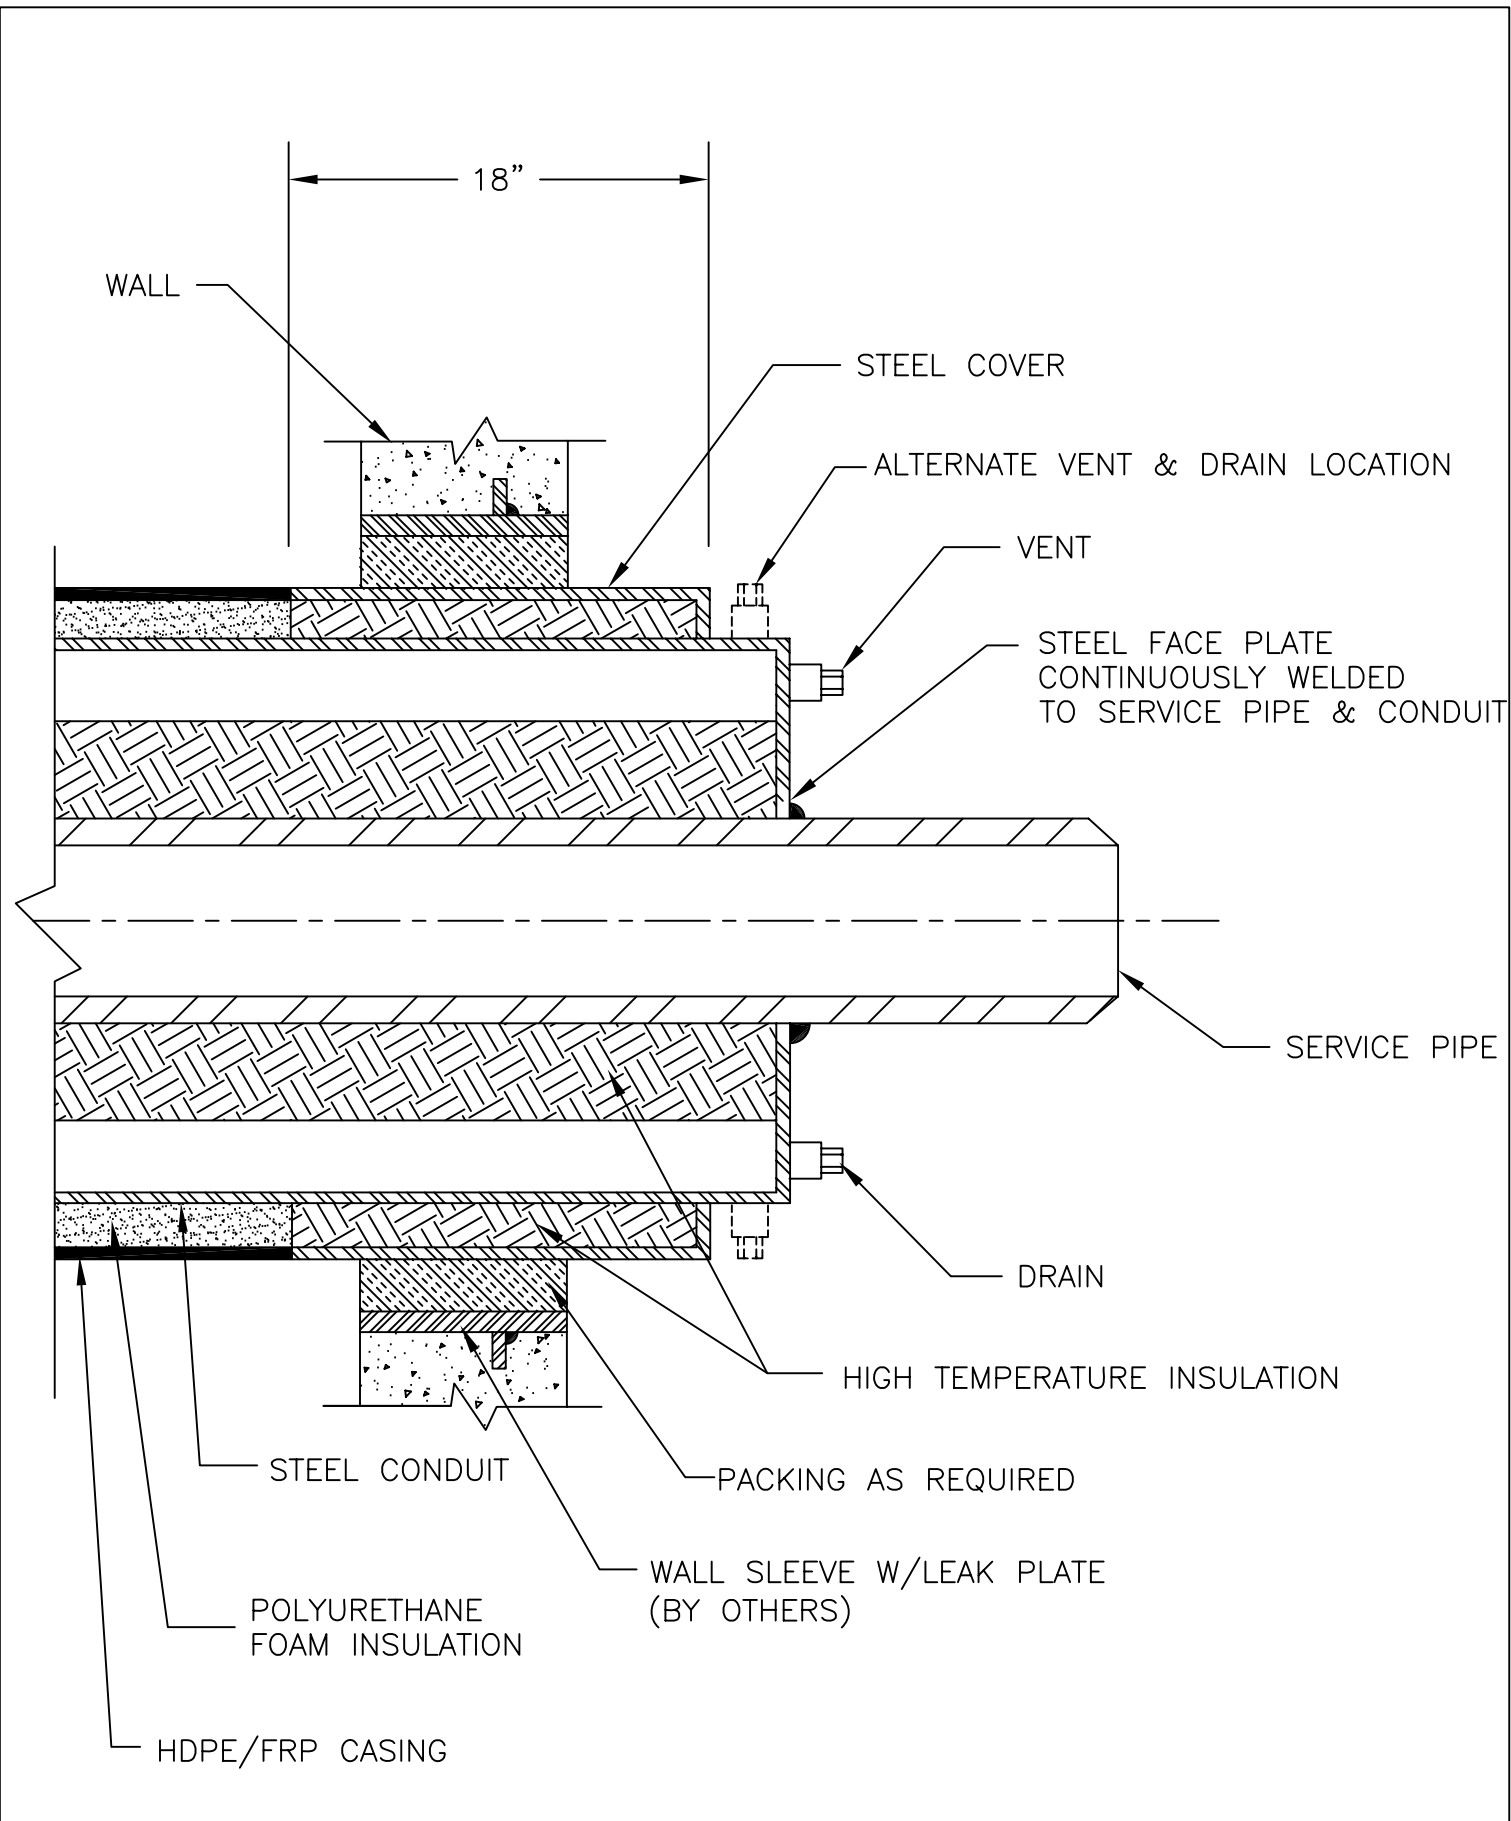

STEEL-CON PLUS WELD END DETAIL



TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032




Tel: 315.697.8787 Fax: 315.697.8788

TRICON STEEL CON PLUS

Date: 03/09/06

Dwg. No.: SCP-7

Rev.:

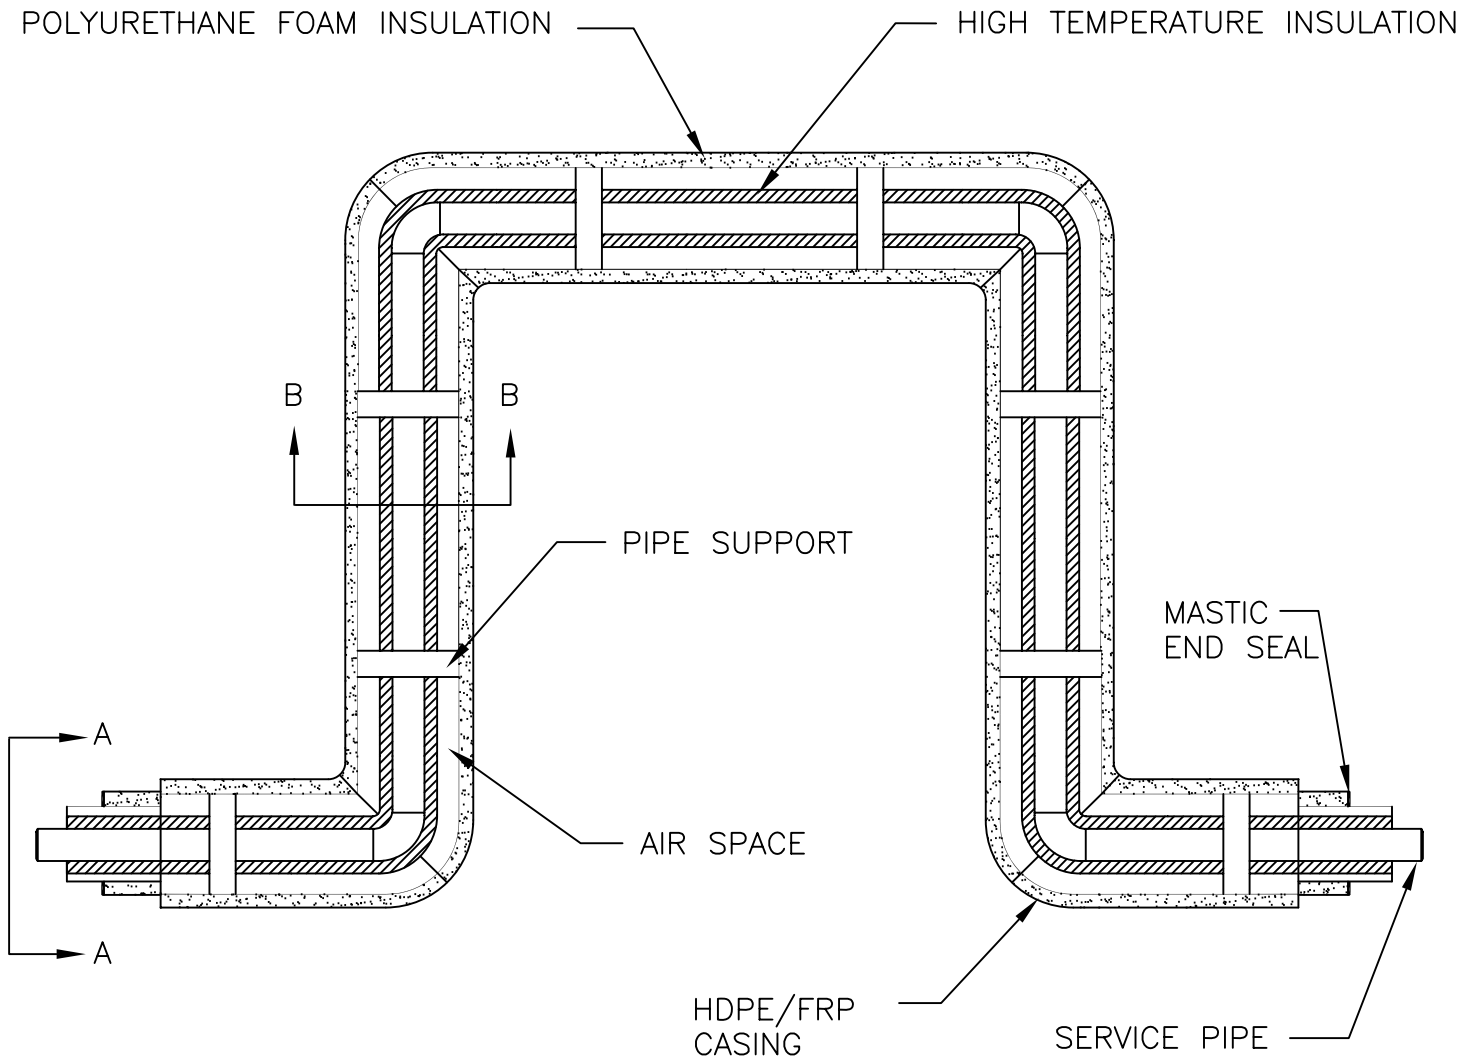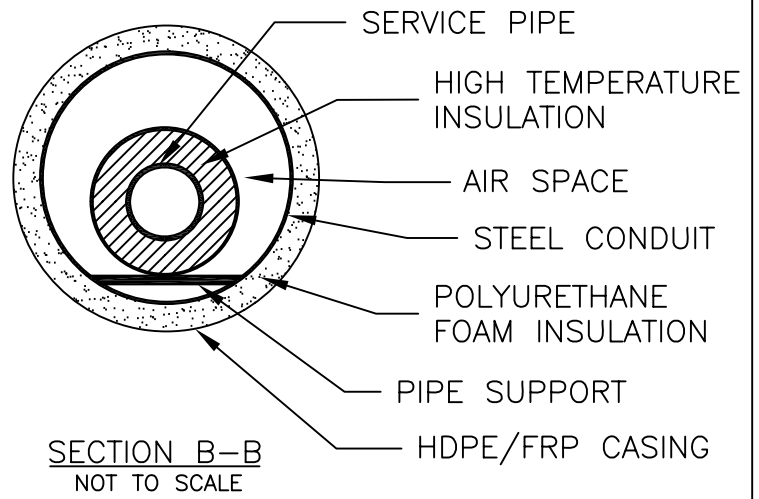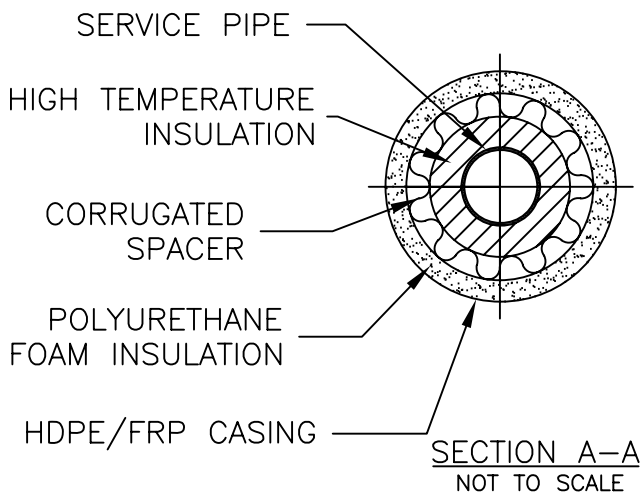

STEEL-CON PLUS EXPANSION LOOP DETAIL

TRICON STEEL CON PLUS

Date: 03/09/06

Dwg. No.: SCP-8

Rev.:



TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

WELDED IN FIELD
AFTER AIR TEST OF
CONDUIT (IF REQUIRED)

STEEL
CARRIER PIPE

CONDUIT PUMP OUT LINE

WATERSHED

CARRIER PIPE
DRAIN LINE

5"

2"

1"

AS REQUIRED

SLOPE
DOWN

TEE

AIR SPACE

1" MAX.

HDPE/FRP JACKET

HIGH TEMPERATURE INSULATION

POLYURETHANE
FOAM INSULATION

STEEL CONDUIT

CONDUIT PUMP-OUT

STEEL-CON PLUS SINGLE DRIP TEE ASSEMBLY WITH WATERSHED



TRICON

Piping Systems, Inc.®

TRICON STEEL-CON PLUS


Date: 03/09/06

Dwg. No. SCP-9

Rev.:

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

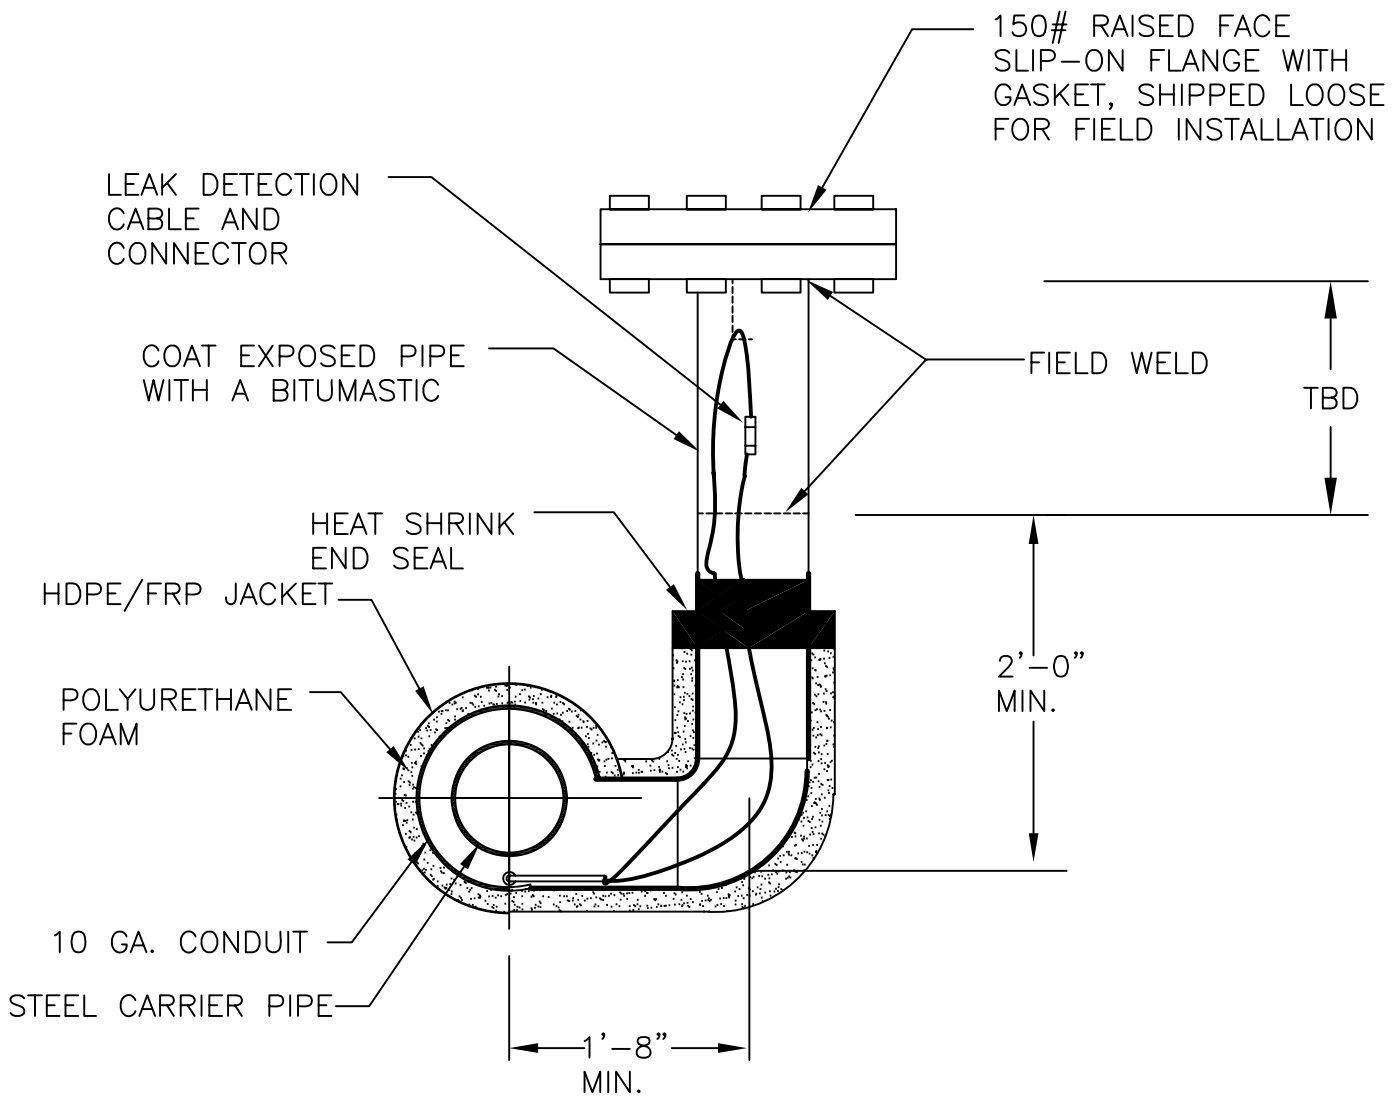

STEEL-CON PLUS PULL PORT TEE DETAIL

TRICON STEEL-CON PLUS

Date: 03/09/06

Dwg. No.: SCP-10

Rev.:




TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788

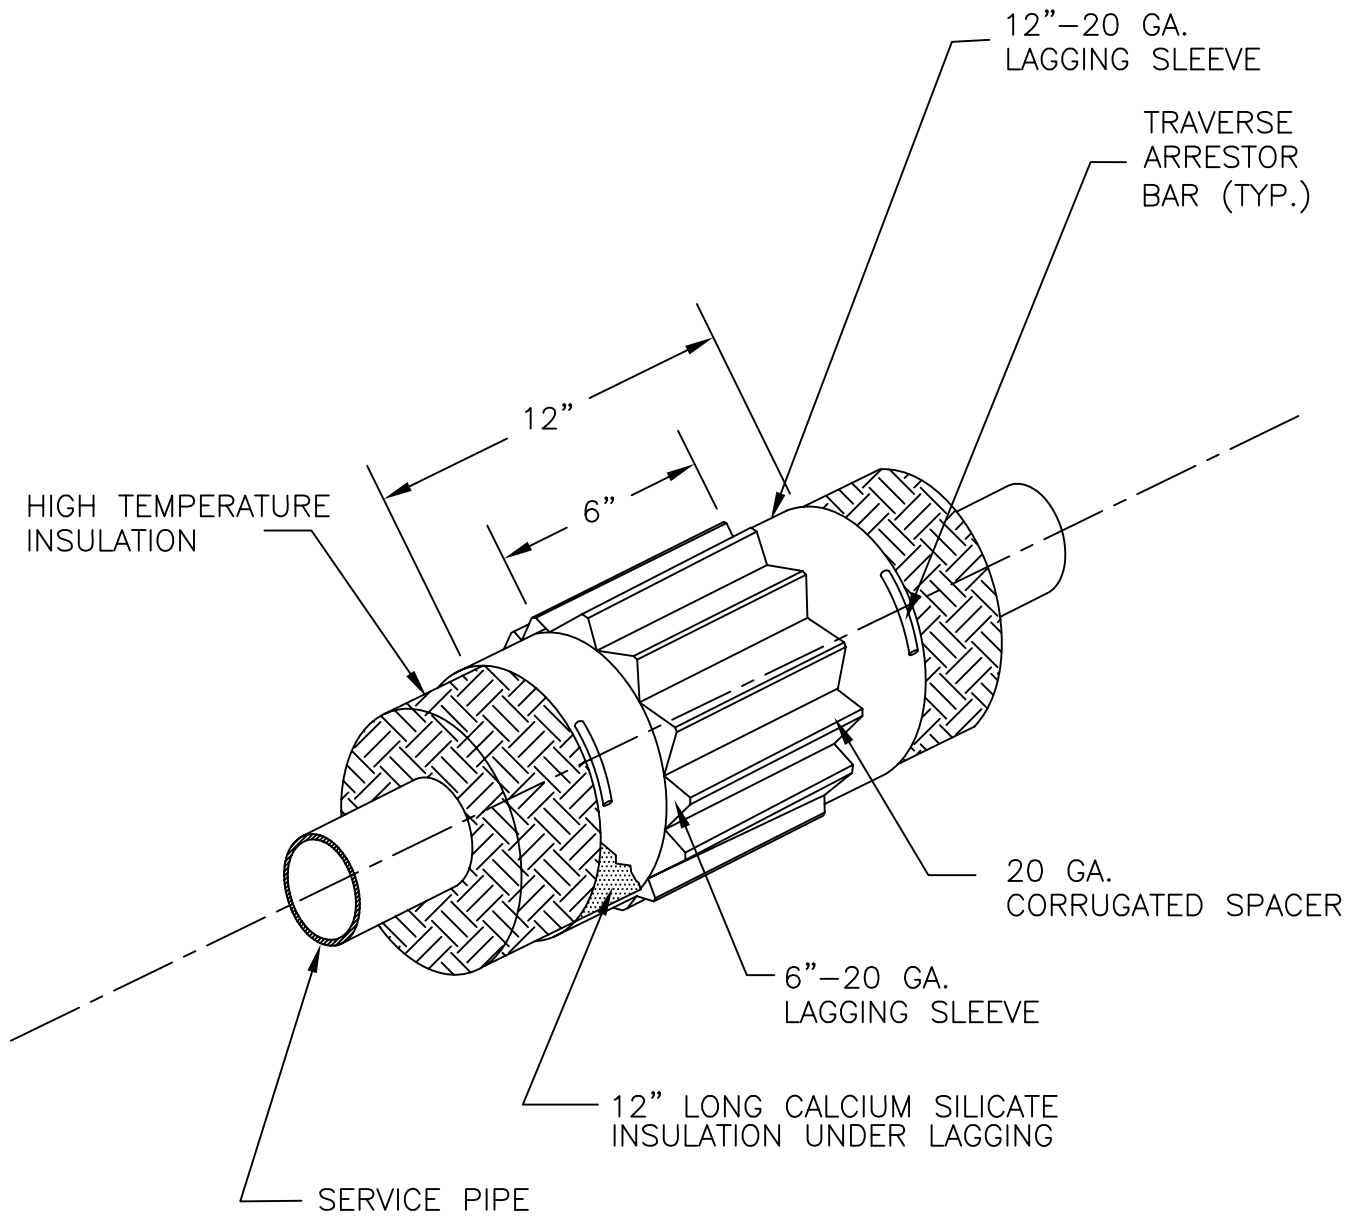

STEEL-CON PLUS PIPE SUPPORT DETAIL

TRICON STEEL CON PLUS

Date: 03/09/06

Dwg. No.: SCP-11

Rev.:



TRICON

Piping Systems, Inc.®

P.O. Box 361, Canastota, New York 13032

Tel: 315.697.8787 Fax: 315.697.8788