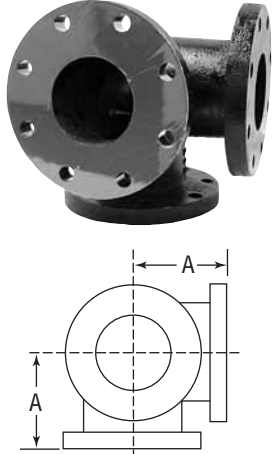


## Cast Iron Flanged Fittings

Class 125 (Standard)

<b>FIGURE 805</b> <b>90° Flanged Base Elbow</b>	Size		Center to Base R		Dia. of Round Base S		Thickness				Size of Supporting Pipe for Base		Unit Weight	
							Base T		Rubs U				Black	
	NPS	DN	in	mm	in	mm	in	mm	in	mm	in	mm	lbs	kg
	3	80	4 <sup>7</sup> / <sub>8</sub>	124	5	127	<sup>9</sup> / <sub>16</sub>	14	<sup>1</sup> / <sub>2</sub>	13	1 <sup>1</sup> / <sub>2</sub>	38	36.00	16.33
	4	100	5 <sup>1</sup> / <sub>2</sub>	140	6	152	<sup>5</sup> / <sub>8</sub>	16	<sup>1</sup> / <sub>2</sub>	13	2	51	59.00	26.76
	6	150	7	178	7	178	<sup>11</sup> / <sub>16</sub>	17	<sup>5</sup> / <sub>8</sub>	16	2 <sup>1</sup> / <sub>2</sub>	64	110.00	49.89
	8	200	8 <sup>3</sup> / <sub>8</sub>	213	9	229	<sup>15</sup> / <sub>16</sub>	24	<sup>7</sup> / <sub>8</sub>	22	4	102	158.00	71.66
	10	250	9 <sup>3</sup> / <sub>4</sub>	248	9	229	<sup>15</sup> / <sub>16</sub>	24	<sup>7</sup> / <sub>8</sub>	22	4	102	224.00	101.59
	12	300	11 <sup>1</sup> / <sub>4</sub>	286	11	279	1	25	1	25	6	152	324.00	146.94

Bases, when drilled, should be drilled to the template of the flange of the supporting pipe size. Size of base determined by size of largest opening of fitting. Bases will be furnished not faced and not drilled unless otherwise specified. When ordered faced, dimensions "R" and "T" will be slightly less than shown in table.

<b>FIGURE 808</b> <b>90° Flanged Side Outlet Elbow</b>	Size		A		Flange Diameter		Thickness				Unit Weight	
							Flange		Wall		Black	
	NPS	DN	in	mm	in	mm	in	mm	in	mm	lbs	kg
	4	100	6 <sup>1</sup> / <sub>2</sub>	165	9	229	<sup>15</sup> / <sub>16</sub>	24	<sup>1</sup> / <sub>2</sub>	13	59.00	26.76
	6	150	8	203	11	279	1	25	<sup>9</sup> / <sub>16</sub>	14	96.00	43.54
	8	200	9	229	13 <sup>1</sup> / <sub>2</sub>	343	1 <sup>1</sup> / <sub>8</sub>	29	<sup>5</sup> / <sub>8</sub>	16	150.00	68.03

Note: See page 62 for pressure-temperature ratings.