PDW30 Point-to-Point Wireless Bridge Instruction Manual



Wireless System

- Signal Wire Replacement in a Rugged, Industrial Housing
- Simple to Order, Configure, & Install
- Range: 1 Mile Line-of-Sight, 500 ft. Indoor
- Analog & Digital Inputs and Outputs, RS-485 Communications
- Remote or Attached Antenna
- Repeaters and Directional Antennas Available
- Flanges for Wall or Pipe Mounting
- PC Software Available for Even Easier Setup
- Rugged, NEMA 4X/IP68 Enclosure


PRECISION DIGITAL CORPORATION

233 South Street • Hopkinton MA 01748 USA Tel (800) 343-1001 • Fax (508) 655-8990



Disclaimer

The information contained in this document is subject to change without notice. Precision Digital makes no representations or warranties with respect to the contents hereof and specifically disclaims any implied warranties of merchantability or fitness for a particular purpose.

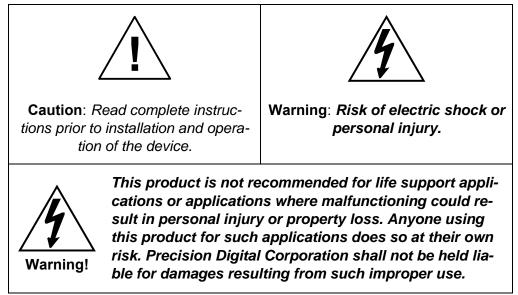

Limited Warranty

Precision Digital Corporation warrants this product against defects in material or workmanship for the specified period under "Specifications" from the date of shipment from the factory. Precision Digital's liability under this limited warranty shall not exceed the purchase value, repair, or replacement of the defective unit.

Registered Trademarks

Modbus[®] is a registered trademark of Schneider Electric. All other trademarks mentioned in this document are the property of their respective owners.

© 2017 Precision Digital Corporation. All rights reserved.

www.predig.com

Table of Contents

Table of Contents	3	
Table of Figures		
Introduction		
Ordering Information		Se
Specifications		00
General		
Isolated 4-20 mA Transmitter Output		
Digital Input / Output Terminal	5	
RS-485 Modbus® RTU Serial Comms		
PDW Manager Software	6	
Safety Information		
Installation	6	
Unpacking	6	
Pre-Installed Conduit Plug	7	
Mounting Instructions	7	
Cover Jam Screw		
FCC Notice		
IMPORTANT		Tr
Canada (IC) Notice		•••
Connections		M
Power Connector		РГ
Signal Connector		
	10	

4-20 mA Output Connector	10
Digital I/O Connector	
Modbus RTU Serial Communications	
Setup and Programming	12
Overview	
Programming Buttons	
Quick Tip	
PDW Manager Software	
Display Functions & Messages	
Primary Unit	15
Secondary Unit	16
Setup Menu	
Entering Numeric Values	17
Primary Device Menus	18
Secondary Device Menus	21
Display Signal I/O and Digital I/O Status	
Programming with PDW Manager	22
Froubleshooting	
Factory Defaults & User Settings	28
Mounting Dimensions	
PDA6963 Stainless Steel Pipe Mounting Kit	29

Table of Figures

Figure 1. PDW30 Device Assembly, Rear View	8
Figure 2. Power Connections	
Figure 3. PDW30 and 2-Wire Transmitter Powered from Same Supply	
Figure 4. Analog Input Connections	
Figure 5. 4-20 mA Output Connections	
Figure 6. Digital I/O Connections	
Figure 7. Three- and Five-Wire RS-485 Modbus Connections	
Figure 8. Multiple Device RS-485 Modbus Connection	
Figure 9. Enclosure Dimensions – Front View	
Figure 10. Enclosure Dimensions – Side Cross Section View	
Figure 11. PDA6963 Stainless Steel Pipe Mounting Kit	
······································	

Introduction

The Precision Digital PDW30 gives you a simple, straightforward way to get an analog, discrete, or Modbus[®] signal from where you have it to where you need it. It's a point-to-point wireless bridge packaged in a rugged, weather tight housing designed to meet the demands of industrial installations.

The PDW30 is simple to order, simple to configure, and easy to trust with your application. Guaranteed ranges assure it will work with your application, or you can send it back - no questions asked. A wireless survey tool is available for those who may require a site survey for longer distances, making it easy to verify the installation will work the first time.

The PDW30 takes an analog, discrete, or Modbus[®] input and wirelessly broadcasts it to a second PDW30 unit. The secondary unit then recreates that signal at its location. The secondary unit may also transmit its own analog, discrete, or Modbus signals back to the primary unit. Just put the units in the field anywhere you have a signal and power.

A wide range of accessories, including mounting kits, antenna-related accessories, and repeaters, are available. The antenna may be directly attached or remotely located. High gain directional antennas are also offered.

Ordering Information

Standard Model

	Model Description	
	PDW30-SNA	PDW30 Point-to-Point Wireless Bridge
Α	ccessories	
	Model Description	
	PDA10	PDW Wireless Signal Strength Survey Tool

woder	Description
PDA10	PDW Wireless Signal Strength Survey Tool
PDA3120-N	RP-SMA F to N Male Antenna Cable 20ft
PDA3140-N	RP-SMA F to N Male Antenna Cable 40ft
PDA3120-S	RP-SMA M/F Antenna Cable 20ft
PDA3140-S	RP-SMA M/F Antenna Cable 40ft
PDA3900-12-N	PDW 900 MHz Antenna, 1/2" NPT
PDA3900-34-N	PDW 900 MHz Antenna, 3/4" NPT
PDA3900-6Y-N	Yagi Antenna 6dB
PDA3900-9Y-N	Yagi Antenna 9dB
PDA6963	Stainless Steel PDW30 Mounting Kit
PDA-MICROUSB	Micro-USB PC Programming Cable (Included)
PDW30-RNA	PDW30 Repeater Kit

Specifications

Except where noted all specifications apply to operation at +25°C.

General

General	
Display	32-character dual-line alphanumeric
	dot matrix LCD display with back-
Disular	light (4.68mm x 2.21mm characters)
Display Orientation	Display may be mounted at 180° from default orientation
Network ID	Field selectable: 0 - 99
Programming	Four programming buttons (behind
Methods	glass) or PC with PDW Manager soft-
	ware.
Recalibration	All inputs and outputs are calibrated
	at the factory. Recalibration is rec-
	ommended at least every
	12 months.
Process/	Press the <i>display</i> button once to
Digital I/O Display	display the present analog input and output. Press the <i>display</i> button
uspiay	again to display digital I/O states.
Password	A programmable password restricts
	modification of program settings.
Power	12-28 VDC, 5 W max
Non-Volatile	All programmed settings are stored
Memory	in non-volatile memory for a mini-
	mum of ten years if power is lost.
Isolation	500 V
Environmental	Operating temp. range: -40 to 65°C
	(display inoperable < -20 °C) Storage temp. range: -40 to 85°C
	Relative humidity: 0 to 90% non-
	condensing
Connections	Removable screw terminal blocks
	accept 16 to 30 AWG wire.
Enclosure	Cast aluminum with glass window,
	0.3% max copper content, corrosion
	resistant powder coating, color: blue. NEMA 4X/IP68. Three ½" NPT
	threaded conduit openings. One $\frac{1}{2}$ "
	NPT stainless steel conduit plug
	with 10 mm hex key fitting installed.
Mounting	May be mounted directly to conduit.
	Two mounting holes for 1.5" pipe or
	wall mounting. See Mounting Di-
	mensions on page 29 for mounting
Signal Con-	space requirements. 2.5 lb-in (0.28 Nm)
nector Tight-	
ening Torque	
Shipping	17" x 14" x 9" (43.2 cm x 35.6 cm x
Dimensions	22.9 cm) (L x Ŵ X H)
Shipping	5 lbs. (2.27 kg)
Weight	
Warranty	3 years parts & labor

0n al +25 C.				
Analog Input				
Inputs Field selectable: 4-20 mA, 0-10 V, 0-5 V, 1-5 V				
Accuracy	±0.03% of calibrated span ±1 count			
Temperature Drift	0.005% of calibrated span/°C max from 0 to 65°C ambient, 0.01% of calibrated span/°C max from -40 to 0°C ambient			
Input Impedance	Voltage ranges: greater than 110 k Ω ; Current ranges: less than 220 Ω			
Signal Loss	Inputs will remain off (open circuit) until wireless units are reconnected.			
HART Transparency	Analog input will not interfere with existing HART communications on the wired 4-20 mA signal			
Isolated 4-20) mA Transmitter Output			
Output Source	Analog input from connected wire- less unit			
Calibration	Factory calibrated: 4.000 to 20.000 = 4-20 mA output			
Accuracy	± 0.1% of span ± 0.004 mA			
Loop Power Supply	Internally powered; no external sup- ply needed			
Temperature Drift	0.4 μ A/°C max from 0 to 65°C ambient, 0.8 μ A/°C max from -40 to 0°C ambient			
Signal Loss	mA output will become 3.2 mA after approx. 25 seconds			
Output Loop Resistance	Power supply Minimum Maximum 24 VDC 10-ohms 900-ohms			
Digital Input	/ Output Terminal			
Channels	Four (4) digital connections, inde- pendently field selectable as either inputs or outputs			
DI Logic High	3 to 5 VDC			
DI Logic Low	0 to 1.1 VDC			
DI Contact	Dry contact to ground can be used			
	to activate the input			
DO Logic High	3 to 5 VDC			
DO Logic Low	0 to 0.4 VDC			
Source Current	10 mA maximum output current			
Sink Current	1.5 mA minimum input current			
Signal Loss	Digital output goes to logic high			

PDW30 Point-to-Point Wireless Bridge Instruction Manual


Wireless Radio

Frequency	900 MHz
Range	500 ft (152.4 m) indoor, 1 mi (1.61 km) outdoor (line-of-sight)
Encryption	AES 128-bit encryption available using PDW Manager software
Interference Reduction	Frequency Hopping Spread Spec- trum (FHSS)
Power Output	24 dBm (250 mW)
Sensitivity	-101 dBm

RS-485 Modbus® RTU Serial Comms

Compatibility	EIA-485	
Connectors	Removable screw terminal con-	
	nector	
Max Distance	3,937' (1,200 m) max	
Baud Rate	1200 – 57,600 bps	
Data	8 bit (1 start bit, 2 stop bits)	
Parity	Even, Odd, or None with 2 stop bits	
Modbus	0.5, 1, 2, 3, 4, 5 seconds;	
Timeout	user selectable	
PDW Manag	ger Software	
System	Microsoft [®] Windows [®]	
Requirements	XP/Vista/7/8/10	
Communica-	USB 2.0 (Standard USB A to Micro	
tions	USB B)	
Configuration	Configure devices one at a time	

Safety Information

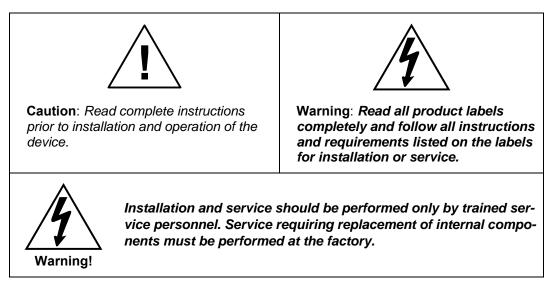

Installation

All pushbuttons and wiring connectors are accessed by opening the enclosure. To access electrical connectors, remove the 2 captive screws and remove the display assembly.

Unpacking

Remove both units from box. Inspect the packaging and contents for damage. Report damages, if any, to the carrier. If any part is missing or the units malfunction, please contact your supplier or the factory for assistance.

Pre-Installed Conduit Plug

The PDW30 is supplied with one pre-installed optional conduit plug for installations that do not require the use of both conduit entries. The conduit plug includes an internal hexagonal socket recess for removal.

Mounting Instructions

The PDW30 has two mounting holes that may be used for a 1.5" pipe mounting or wall mounting. Alternatively, the unit may be supported by the conduit using the conduit holes provided. The antenna is threaded into one of the three conduit holes and may be moved as appropriate for the installation.

It can also be mounted by using the PDA6963 mounting bracket in order to orient the device antenna away from the pipe. Refer to Mounting Dimensions on page 29 for details on wall or panel space requirements.

Cover Jam Screw

The cover jam screw should be properly installed once the wireless units have been wired and tested in a safe environment. The cover jam screw is intended to prevent the removal of the units' cover while in operation without the use of tools. Using a M2 hex wrench, turn the screw clockwise until the screw contacts the unit. Turn the screw an additional 1/4 to 1/2 turn to secure the cover.

Caution: Excess torque may damage the threads and/or wrench.

FCC Notice

Contains FCC ID: MCQ-XB900HP

The enclosed device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (i.) this device may not cause harmful interference and (ii.) this device must accept any interference received, including interference that may cause undesired operation.

IMPORTANT

The RF module has been certified for remote and base radio applications. If the module will be used for portable applications, the device must undergo SAR testing. This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation.

If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures: Re-orient or relocate the receiving antenna, Increase the separation between the equipment and receiver. Connect equipment and receiver to outlets on different circuits, or consult the dealer or an experienced radio/TV technician for help.

Canada (IC) Notice

Contains Model: XB900HP, IC: 1846A-XB900HP

Integrator is responsible for its product to comply with IC ICES-003 & FCC Part 15, Sub. B - Unintentional Radiators. ICES-003 is the same as FCC Part 15 Sub. B and Industry Canada accepts FCC test report or CISPR 22 test report for compliance with ICES-003.

Connections

To access the connectors, remove the enclosure cover and unscrew the two captive stainless steel screws. Remove the electronics assembly from the enclosure. Signal connections are made to removable terminal blocks on the back of the electronics assembly. Grounding connections are made to the two ground screws provided on the base – one internal and one external.

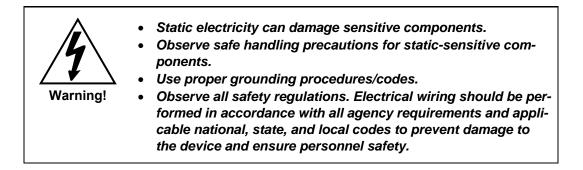


Figure 1 below shows the locations of screw terminal blocks on the rear of the wireless unit assembly.

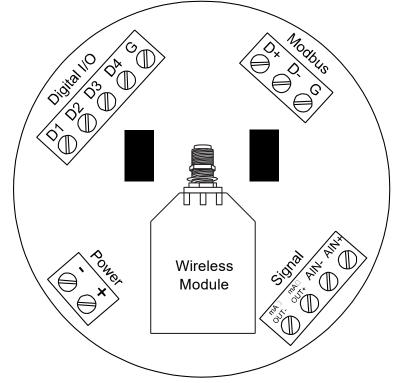


Figure 1. PDW30 Device Assembly, Rear View

Power Connector

Power connections are made to a two-terminal connector labeled POWER in Figure 1. The PDW30 is reverse polarity protected; it will not be damaged if wired backward. Make sure that the power supply can provide between 12 and 28 VDC to the wireless device.




Figure 2. Power Connections

Power PDW30 and 2-Wire Transmitter from Same Power Supply

The PDW30 wireless units may be powered from the same power supply that powers the 2-wire (looppowered) transmitter, assuming that the supply provides enough voltage for both units. To power both devices from the same supply, wire the devices to the supply as shown below.

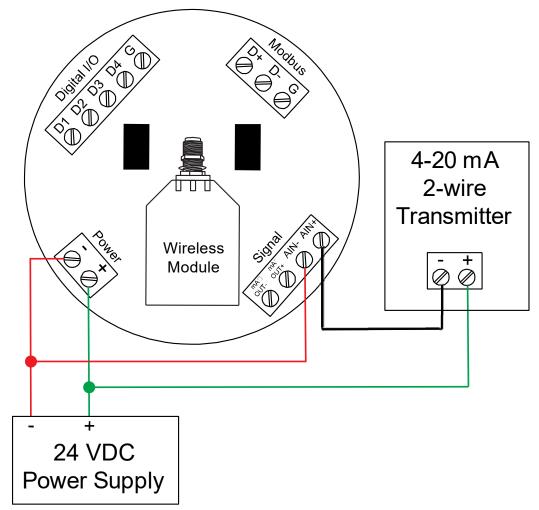


Figure 3. PDW30 and 2-Wire Transmitter Powered from Same Supply

Signal Connector

The analog input may be either 4-20 mA, 0-10 V, 0-5 V, or 1-5 V. The appropriate input type must be programmed for each unit.

Once the appropriate input type has been programmed, wire the analog signal source to the device as shown in the diagram at right.

The analog input will not interfere with any existing HART signal on a 4-20 mA current loop. However, the HART signal **will not** be transmitted wirelessly.

4-20 mA Output Connector

The 4-20 mA output corresponds with the analog input signal on the paired wireless device. The analog output signal is always 4-20 mA, regardless of the input type on the other wireless module.

For instance, if the analog input type on the first device was 0-10 V and the input value was 5 V, the second device would output 12 mA.

Connect the *mA OUT* terminals to a device scaled to read a 4-20 mA signal.

The analog output is internally powered; no external power supply is required.




Figure 4. Analog Input Connections

Signal





Figure 5. 4-20 mA Output Connections

Digital I/O Connector

All digital connections are referenced to ground. The primary unit digital I/O settings determine the settings of the secondary unit (e.g. if D1 of the primary unit is an input then D1 of the secondary unit in an output).

Note: Each connection may be set independently in the device settings as either an input or an output. In the diagram to the right, D4 & D3 are digital inputs and D2 is a digital output.



Modbus RTU Serial Communications

The PDW30 acts as a simple pass-through for Modbus communications. As such, multiple Modbus enabled devices may be transmitted wirelessly using the PDW30 Wireless Bridge.

Note: Modbus Master must be connected to Primary Wireless Unit.

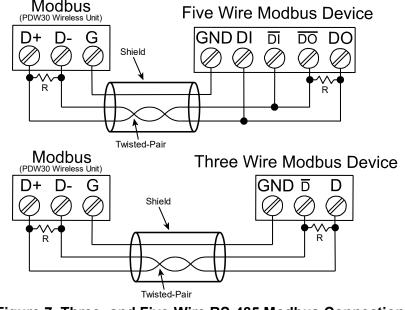


Figure 7. Three- and Five-Wire RS-485 Modbus Connections

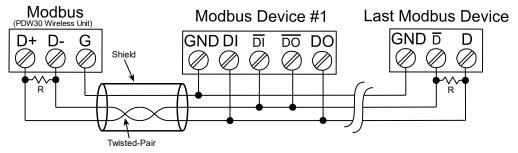


Figure 8. Multiple Device RS-485 Modbus Connection

Notes:

- 1. Termination resistors are optional and values depend on the cable length and characteristic impedance. Consult the cable manufacturer for recommendations.
- 2. Use shielded cable, twisted-pairs plus ground. Connect ground shield only at one location.

11

Figure 6. Digital I/O Connections


Setup and Programming

The units are factory calibrated prior to shipment to read in milliamps or volts depending on the input selection. The calibration equipment is certified to NIST standards.

Overview

There are no jumpers to set for wireless device input selection.

Setup and programming is done through the programming buttons located underneath the enclosure cover or using the PDW Manager software. After power and input signal connections have been completed and verified, apply power to the device.

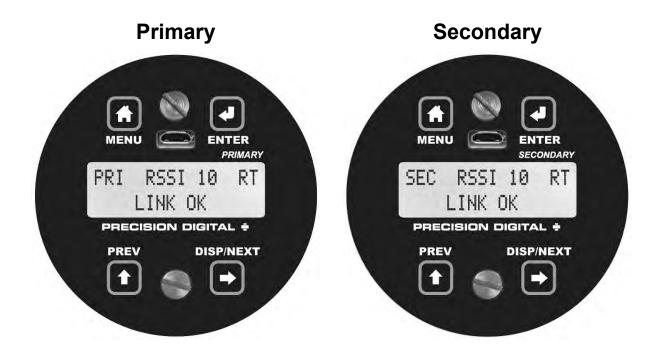

Programming Buttons

The units can be programmed using the buttons located behind the enclosure cover. Use the *menu* button to enter or exit *programming mode*, the *next* button to cycle forward through menu options, the *previous* button to cycle backward through menu options, and the *enter* button to select the menu item or option you want.

During number entry, use the *next* button to select a digit and the *previous* button to increment the selected digit.

Press the *display* button while in *run mode* to show the current analog and digital inputs and outputs.


Button	Description	Display	Status
MENU	Menu Enter or exit the de- vice menu	RSSI	Received Signal Strength Indicator Indicates the wireless signal strength between wireless devices on a scale of 1 to 10.
ENTER	Enter Select a menu item of option	RT	<u>R</u>eceiving/<u>T</u>ransmitting Flashes while the devices are sending and/or receiving data
PREV	Previous Cycle backward through menus or in- crement digit	PRI / SEC	Primary/Secondary Indicates whether the device is the pri- mary unit or the secondary unit. This distinction is fixed and cannot be changed.
DISP/NEXT	Next Cycle forward through menus or select next digit	LINK OK/ CONNECTING	Link Status Displays whether or not the units are currently connected
	Display Show current inputs and outputs	AIN / AOUT	Analog Input/Analog Output Labels for the current analog input and analog output (Shown when the <i>display</i> button is pressed)
		DI / DO	Digital Input/Digital Output Labels for each of the current digital in- puts or outputs (Shown when the <i>display</i> button is pressed twice)

Quick Tip

While programming the wireless units, it may be useful to view the current signal or digital I/O in order to ensure that the correct signals are reaching the units. Pressing either the *previous* or *display* buttons while the device is in run mode will cycle through the unit's display modes which are, in order, *link status, analog I/O*, and *digital I/O*.



The wireless transmission is interrupted while the unit is in *Programming Mode*. Press Menu to return to *Run Mode*.



PDW Manager Software

The units can also be programmed using the PC based *PDW Manager*. Units connect to a PC via the micro USB connection on their face, underneath the enclosure cover.

Use of PDW Manager is required for programming advanced settings, such as wireless encryption, and analog signal calibration.

Note: Units must b	e powered externall	y prior to p	programming via USB.	
--------------------	---------------------	--------------	----------------------	--

PDW Manage	er - SFT103 v1.000	- 9 X
Device;		
PD Wineless Fiel	Id Unit - SN: D8F9806F16000800 - FWy v1.100	Disconnect
Configuration	Calibration - Analog Input Calibration - 4-20mA Output IO Testing Advanced About	_
	Device Name: #7 Change Name Device Type: Primary Unit Device Settings: Network ID: Network ID: 1 Analog Input Mode: 4-20 mA • Digital I/O #1 Direction: Output • Digital I/O #2 Direction: Output • Digital I/O #3 Direction: Input • Digital I/O #4 Direction: Input • Digital I/O #3 Direction: Input • Digital I/O #4 Direction: Input • Modbus Timeout: 1 sec • Modbus Data Format: 8-bit Data; Even Parity; 1 Stop-bit • Read Settings: Save Settings:	

PDW Manager is available on the included CD or online at www.predig.com/PDWManager.

Instructions on the use of PDW Manager to program the PDW30 wireless units can be found under Programming with PDW Manager on page 22.

Display Functions & Messages

Shown below is a list of all display messaged in each device's setup menu. This list is in order of appearance when pressing the *next* button. An indented line indicates a sub-menu or item.

Display	Action/Setting Description
ANALOG INPUT SETUP	Change the analog input type
ANALOG INPUT	Displays the current analog input type (press <i>enter</i> to change)
4-20mA	Set the analog input to 4-20 mA
0-10V	Set the analog input to 0-10 V
0-5V	Set the analog input to 0-5 V
1-5V	Set the analog input to 1-5 V
BACK TO SETUP MENU	Return to the setup menu
DIGITAL IO SETUP	Change whether each digital connection is an input or an output
DIGITAL I⁄O #1	Displays digital connection #1's current setting (press enter to change)
INPUT	Set the selected digital connection to input
OUTPUT	Set the selected digital connection to output
DIGITAL I/O #2	Displays digital connection #2's current setting (press enter to change)
DIGITAL I⁄O #3	Displays digital connection #3's current setting (press enter to change)
DIGITAL I⁄O #4	Displays digital connection #4's current setting (press enter to change)
BACK TO SETUP MENU	Return to the setup menu
NETWORK AND MODBUS SETUP	Change settings related to wireless network and Modbus $^{\ensuremath{\mathbb{B}}}$ input
NETWORK ID	Displays the point-to-point wireless network ID (press enter to change)
01-99	The network ID can be any number between 01 and 99
MODBUS TIMEOUT	Displays the Modbus timeout setting (press enter to change)
1 SEC	1 second timeout
2 SEC	2 second timeout
3 SEC	3 second timeout
4 SEC	4 second timeout
5 SEC	5 second timeout
0.5 SEC	0.5 second timeout
MODBUS BAUD RATE	Displays the Modbus baud rate setting (press enter to change)
9.6K	9.6 K baud rate
19.2k	19.2 K baud rate
28.8k	28.8 K baud rate
38.4k	38.4 K baud rate
57.6k	57.6 K baud rate
1.2k	1.2 K baud rate
2.4k	2.4 K baud rate
4.8k	4.8 K baud rate

PDW30 Point-to-Point Wireless Bridge Instruction Manual

Display	Action/Setting Description
DATA FORMAT	Displays the Modbus data format setting (press enter to change)
8E1	Data format 8E1
801	Data format 801
8N2	Data format 8N2
BACK TO SETUP MENU	Return to the setup menu
PASSWORD SETUP	Change the device password
PASSWORD (0=OFF)	Displays the current device password (press enter to change)
0000-9999	Password can be any number from 0001 to 9999 (0000 disables)
BACK TO SETUP MENU	Return to the setup menu
RESTORE DEFAULTS	Restore the unit to factory default settings
LOAD DEFAULTS?	Factory restoration confirmation prompt
NO	No, do not restore the device to factory defaults (press enter)
YES	Yes. restore the device to factory defaults (press enter)


Secondary Unit

Display	Action/Setting Description		
NETWORK ID	Displays the point-to-point wireless network ID (press enter to change)		
01-99	The network ID can be any number between 01 and 99		
ANALOG INPUT	Displays the current analog input type (press enter to change)		
4-20mA	Set the analog input to 4-20 mA		
0-10V	Set the analog input to 0-10 V		
0-5V	Set the analog input to 0-5 V		
1-50	Set the analog input to 1-5 V		
MODBUS TIMEOUT	Displays the Modbus timeout setting (press <i>enter</i> to change)		
0.2 SEC	0.2 second timeout		
0.5 SEC	0.5 second timeout		
1 SEC	1 second timeout		
0.1 SEC	0.1 second timeout		
PASSWORD SETUP	Change the device password		
PASSWORD (0=OFF)	Displays the current device password (press enter to change)		
0000-9999	Password can be any number from 0001 to 9999 (0000 to disable)		
BACK TO SETUP MENU	Return to the setup menu		
RESTORE DEFAULTS	Restore the unit to factory default settings		
LOAD DEFAULTS?	Factory restoration confirmation prompt		
NO	No, do not restore the device to factory defaults (press enter)		
YES	Yes. restore the device to factory defaults (press enter)		

Setup Menu

The setup menu consists of analog, digital (discrete), and Modbus[®] input/output settings, network ID, password, and factory defaults restoration.

The *primary* wireless unit determines network protocol and digital I/O settings for the *secondary* unit, simplifying the setup process. For instance, if a digital connection is programmed to be an **input** on the *primary* unit, that same connection will be an **output** on the *secondary* unit. Because of this, the *secondary* wireless unit has fewer menu options than the *primary* unit.

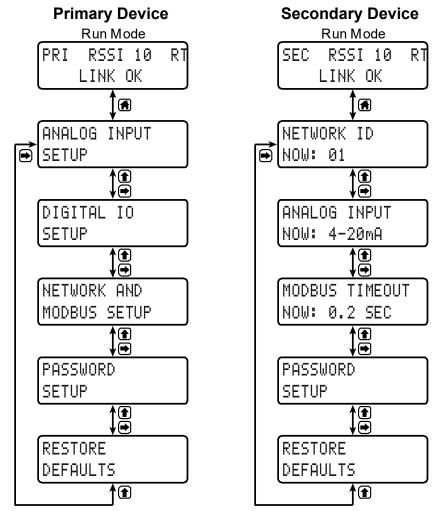

Entering Numeric Values

Numeric values are set using the *next* and *previous* buttons. Press *next* to select next digit and *previous* to increment digit value.

The selected digit will flash.

Press the enter button, at any time, to accept the value or the menu button to exit without saving.


Access	Increment	Select the	Increment selected digit	Accept
edit mode	selected digit	next digit		new value
NETWORK ID NOW: 01		ID ■ NETWORK SET: 11	ID • NETWORK SET: 12	

Primary Device Menus

Analog Input Setup


Enter the Analog Input menu to set up the wireless unit to accept either a current or a voltage input.

The current input is capable of accepting a signal from 4 to 20 mA. The voltage input is capable of accepting a 0 to 10 VDC signal, 0 to 5 VDC signal, or 1-5 VDC signal.

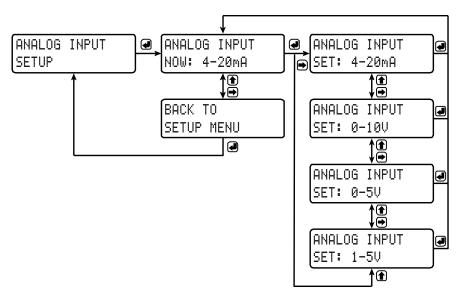


Digital I/O Setup

All four digital connections may be set as either inputs or outputs. The setting on the primary unit determines the corresponding digital connection on the secondary unit. For instance, if digital connection number one is set as an input on the primary unit, it will be an output on the secondary unit. Each digital connection may be set independently as either an input or output.

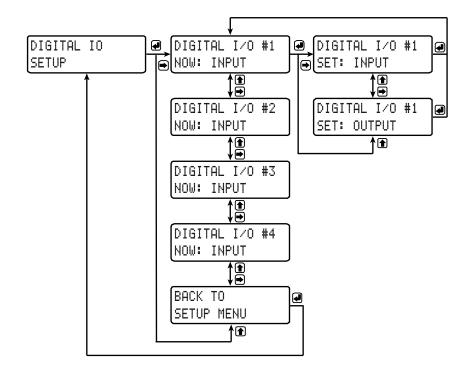

Network and Modbus Setup

The *Network and Modbus Setup* menu is where the wireless device's *Network ID* is set and Modbus[®] serial communications settings are programmed.

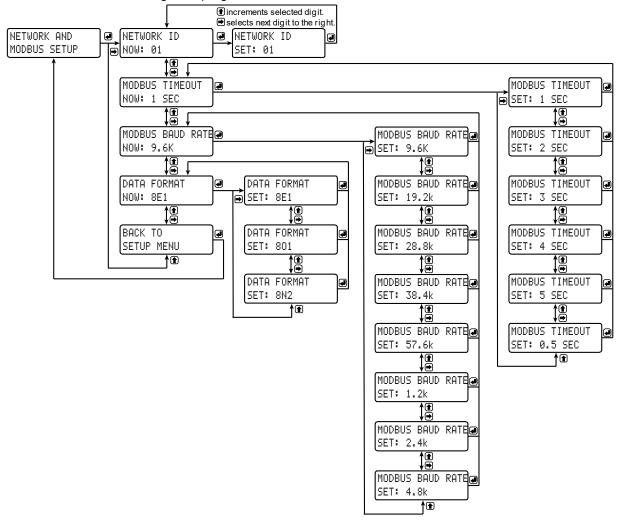

Network ID

The network ID determines *primary* and *secondary* wireless pairs. The primary and secondary units must share the same unique network ID in order to communicate.

Modbus Timeout

The Modbus timeout sets the length of time the wireless devices will wait for a reply from the other Modbus device before returning an error. This should be 1 to 2 seconds at 9600 bps on the primary device.

Modbus Baud Rate

The baud rate of the wireless devices must match the baud rate of the Modbus network in order to prevent collisions on the bus. The baud rate may be set between 1,200 and 57,600 bps.


Data Format

The data format of the wireless devices must match the data format of the Modbus network. Set the data format to either 8E1 (8-bit, even parity, 1 stop bit), 801 (8-bit, odd parity, 1 stop bit), or 8N2 (8-bit, no parity, 2 stop bits).

Password Setup

Both the primary and secondary wireless units may be protected with a four digit numeric password in order to prevent unauthorized tampering. When a password has been set, you will be prompted to enter that password in order to access the device menu.


To disable password protection, simply enter 0000 as the password.

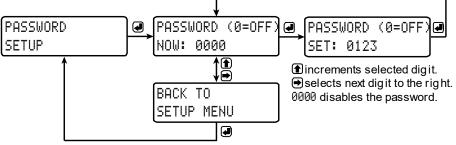

Note: See Entering Numeric Values on page 17 for instructions on how to enter numbers

Making Changes to a Password Protected Wireless Unit

Once a password has been set on the device, you will be required to enter that password before being allowed to access the device menu.

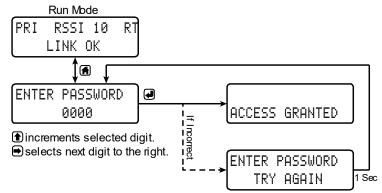


Note: Setting a password will require you to enter the password to access the device settings via the PC software as well.

Did you forget the password?

The password may be disabled by entering a master password. If you are authorized to make changes, enter the master password 7300 to unlock the device.


Restore Defaults

If a mistake has been made while programming the primary or secondary device, and it is unclear where the error occurred, the best option may be to perform a factory reset of the device and begin again.

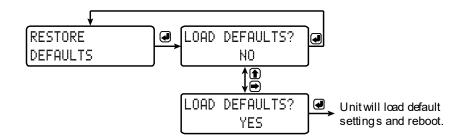


Secondary Device Menus

The secondary device has fewer menu options than the primary device, shown below.

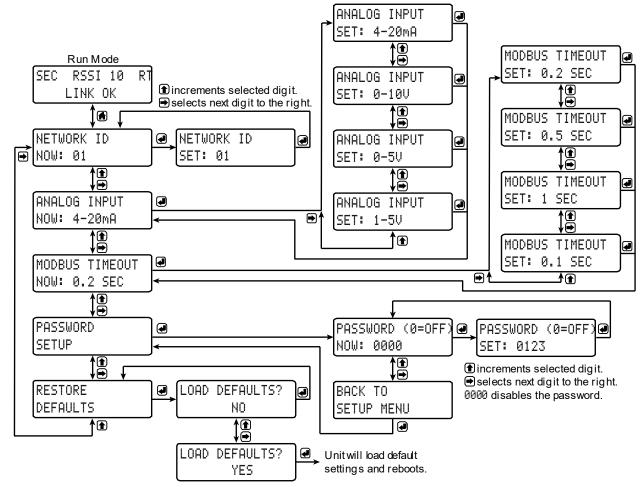

Display Signal I/O and Digital I/O Status


Pressing either the *previous* or *display* buttons while the device is in run mode will cycle through the display modes. These modes are, in order, *link status, analog I/O*, and *digital I/O*.



Programming with PDW Manager

PDW Manager allows you to program the PDW30 wireless units from a PC with a USB connection. Units connect to a PC via the micro USB connection on their face, underneath the enclosure cover. Use of PDW Manager is required for programming advanced settings such as wireless encryption and analog signal calibration.

PDW Manager can be found on the included CD or downloaded from **www.predig.com/PDWManager**. Once the software is running, power the unit using a 12-28 VDC power supply and connect the device to the PC using the provided USB cable.

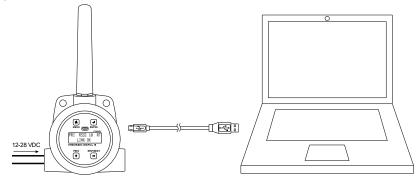

The PC will automatically install the appropriate device drivers. Once this has completed, the device will appear in the *Device* list at the top of the PDW Manager window. Click *Connect*.

PDW Manager - SFT103 v	1,000				- 9 X
Device:					
PD Wireless Field Unit - SN: [08F9806F16000300 - FW: v1.100				* Connect
Base Station Configuration	Base Station IO Configuration	Remote Unit Configuration	Advanced	About	N3


The menu options displayed will vary depending on what type of unit is connected. The PDW30 *primary* unit will have more options than the *secondary* unit. The image below shows the available options on the configuration tab while the *primary* unit is connected.

Denice PD Wratess Field Unit: SNs D8F980/F1600/F800			
P.D. Wireless Fred Linit - SN: D8F980(FL6000600			
	FW: 41.000		Disconnect
Configuration Calibration - Analog Input	libration - 4-20mA Output 10 Testing	Advanced About	
	Device Name: #7	Change Name	
	Device Type: Primary Unit Device Settings: Network ID: 1	÷.	
1	Digital VO =1 Direction: Output -	1	
	Digital I/O #3 Direction: Input • Digital I/O #4 Direction: Input • Modbus Timecut: I sec •		
	Modbus Baud Rate: 9600 + Modbus Data Format: 8-bit Data: E Read Settings Save Settings	ven Panty: 1 Stop-bit •	
Read Settings	Save Settings Click his button to write all of the changes (or) have	Change Password Citick this button to change the password medical to	Disconnect Click this button to disconnect from the PDW30 wreless unit
			Device Type: Pfimary Unit Device Settings: Network ID: 1 Analog Input Mode 4 20 mA Digital UO #1 Direction: Output = Digital UO #2 Direction: Output = Digital UO #3 Direction: Input = Digital UO #4 Direction: Input = Digital UO #4 Direction: Input = Digital UO #4 Direction: Input = Modbus Baud Rate: 9500 = Modbus Data Format: 8-tht Date: Even Ponty: 1 Stop-bit • Read Settings: Save Settings: Change Password Click his button to load settings from the wireless hardware and display them made in the above fields to Click this button to change to change device settings.

The devices' analog inputs and outputs can be calibrated using the Calibration tabs. The IO Testing tab allows you to perform diagnostics and testing on the units.

an entrease treip ontit - alle 00	F3805F2.6000300 - FW:N3 3.00		+ Disconnec
Configuration Calibration - J	Analog Input Calibration = 4-20mA Output 10 Testing A	Advanced About	
	Analog Input Calibration		
	Mode: Current + Samples to Average:	20	
		rd Now Reading: None	
	-pol/ Ciliciation		
		eading: nt: 15.44643 mA	
	i -		
nalog Input Cal	ibration Mode	Input Calibration	
	t calibration mode to either current hange the active analog input mode	Record the high and low analo range from a calibration device	
voltage. This will c			
		calibration to the wireless unit.	
n the device and allo PDW Manager - SFT103 v10	ow for calibration Calibration – 4-20	calibration to the wireless unit.	
n the device and allo PDW Manager - SFT103 v1.0 mice	ow for calibration Calibration – 4-20	calibration to the wireless unit.	
PDW Manager - SF7112 v10 enice Wireless Field Unit - SF6 DBF	ow for calibration Calibration – 4-20	calibration to the wireless unit	
PDW Manager - SF7112 v10 enice Wireless Field Unit - SF6 DBF	w for calibration Calibration – 4-20	calibration to the wireless unit	
PDW Manager - SF7112 v10 enice Wireless Field Unit - SF6 DBF	w for calibration Calibration – 4-20	calibration to the wireless unit	
PDW Manager - SF7112 v10 enice Wireless Field Unit - SF6 DBF	w for calibration Calibration – 4-20	calibration to the wireless unit	
n the device and all PDW Manager - 577102 v10 evice 2 Wireless Field Unit - SNe DBF configuration Calibration - A	ow for calibration. Calibration — 4-20 Sectorescon-rew.str.log analog Input Calibration - 4-20mA Output 10 Testing 4	calibration to the wireless unit	
PDW Manager - 577103 v10 evice 3 Warens Field Unit - Site DBF configuration Calibration - A	w for calibration Calibration – 4-20	calibration to the wireless unit	
PDW Manager - 577103 v10 evice 3 Warens Field Unit - Site DBF configuration Calibration - A	ow for calibration. Calibration — 4-20 ov Meder 20000000 - FW: 91-100 maleg Input Calibration - 4-20mA Output 10 Testing 4 DmA Output Calibration	calibration to the wireless unit	
PDW Manager - SFT103 v10 brice JW releas Field Unit - SNe DBF onfiguration Calibration - A 4 20 Calibration Calibration - A	Calibration - 4-20 Calibration - 4-20 98064250005500 - PWI: 92 100 inalog Input Calibration - 4-20mA Dutput IO Texting A PMA Output Calibration prate Output: 4-mA 20 mA	calibration to the wireless unit	
PDW Manager - SFT 512 v10 evice Wireless Field Unit - SNe DBF onfiguration Calibration - A Calibration - Calibration - A Calibration - Calibration - A	Calibration - 4-20 Calibration - 4-20 Sectorscorecon-Permanico Sect	calibration to the wireless unit	
PDW Manager - SFT 512 v10 evice Wireless Field Unit - SNe DBF onfiguration Calibration - A Calibration - Calibration - A Calibration - Calibration - A	Calibration - 4-20 Calibration - 4-20 Sectorscore- FW: st. for sectorscore- FW: st. for malog Input Calibration - 4-20mA Dutput to Testing A mA Output Calibration prate Output: 4mA 20mA easured Current 4 mA 4000 mA Save Measure saured Current 2 mA 20000 mA Save Measure	calibration to the wireless unit	
n the device and all PDW Manager - SFT122 v10 trice DW releases Calibration - A Calibration - A Calibration - A Calibration - A Calibration - A Calibration - A	Calibration - 4-20 Calibration - 4-20 Sectorscorecon-Permanicol sectorscorecon-Permanicol sectorscorecon-Permanicol sectorscorecon-Permanicol Sectorsc	calibration to the wireless unit	
n the device and all PDW Manager - SFT123 v10 trice 2 Winess Field Unit - SNE DBF configuration Calibration - A 4-22 Calibration Manager	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
n the device and all PDW Manager - SFT123 v10 trice 2 Winess Field Unit - SNE DBF configuration Calibration - A 4-22 Calibration Manager	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	calibration to the wireless unit	
PDW Manager - SFT163 v10 exice Wireless Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
PDW Manager - SFT163 v10 exice Wireless Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
PDW Manager - SFT112 v10 evice DW releas Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
PDW Manager - SFT112 v10 evice DW releas Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
PDW Manager - SFT112 v10 evice DW releas Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscoreco – Period 100 Indeg Input Calibration – 4-20mA Output IO Testing A DraA Output Calibration order Output: 4mA 20mA easured Current 2 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure aured Current 20 mAs 20,0000 mA Seve Measure Apply Calibration	nant Value None	
PDW Manager - SFT112 v10 evice DW releas Field Unit - SNe DBF onfiguration Calibration - A Calibration Calibration - A Calibration Calibration - A	Calibration – 4-20 Calibration – 4-20 Sectorscourses – HWI SELLON Sectorscourses – HWI SELLON Secto	nant Value None	

Calibration – Analog Input

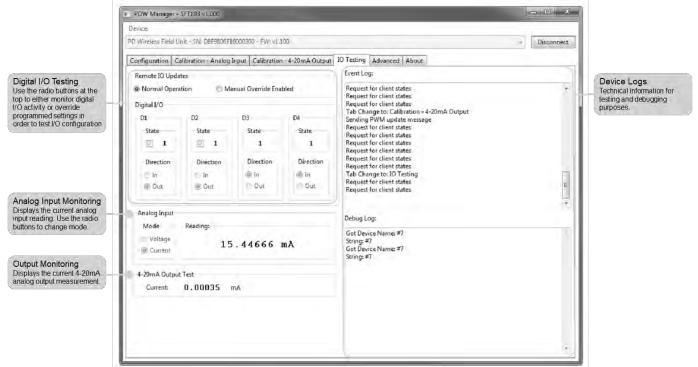

Device communication can be secured by enabling 128-bit AES encryption. A channel mask may also be set for interference immunity. The encryption key and channel mask may be entered on the *Advanced* tab.

encryption in	ve entered the formation, click	FDW Manager - SF1101 v1.000 Device: PD Wireless Field Unit - SN: D89906F1600300 - FW v2.000
Save Setting devices musical encryptio	rs. The wireless t share identi- n keys in order ate, so be sure	PC Wirsteas Field Unit - Ski: DB19806128000300 - FW v3.200 Betwork Settings: Contiguration Calibration - Analog Input: Calibration - 4-20mA Durput: JD Testing Advanced About Betwork Settings: Channel Mark: 0x5FFFFFFFFFF AES Encryption: Disabled • Encryption Key Bytes 15 - 8: 0x00000000000 Encryption Key Bytes 7 - 0: 0x00000000000 AES Encryption Key Bytes 7 - 0: 0x000000000000 Reset all device parameters to Factory Defaults Reset all device parameters to Factory Defaults Click this button to load settings from Reset for Factory Defaults Click this button to load settings from
		the wireless unit hardware and display them here. This will overwrite any changes you have made in the software. by u have made to the device. changes you have made in the software. changes you have made you have have you have have have have you have you have you have have you have yo

IO Testing

Troubleshooting

If you are experiencing difficulties with your wireless installation, consult the troubleshooting steps listed below. For best results, identify the symptoms of the problem you are having and attempt all of the corrective actions listed for the particular symptom.

Symptom	Possible Cause	Corrective Action
Devices will not connect.	Devices have mismatched net- work IDs.	 Devices will not connect if they do not have the same network ID. Verify that both devices share the same network ID.
	Devices are out of range or there are obstacles block- ing the wireless path.	 Bring devices closer together to see if it alleviates the issue. Units will display LINK OK if they are connected. If devices connect, consider placing closer together permanently, removing any obstacles, or mounting higher. Ensure antennas are on parallel plane. Devices that are vertically separated will not have as strong of a connection. If communicating over distance of miles, consider installing PDW30-RNA repeaters or a high gain directional antenna.
	Multiple wireless devices in the area with the same ID.	 If there are multiple PDW30 wireless bridges verify that each pair has its own unique net- work ID.
	Encryption keys do not match	 If using encryption, ensure that the encryp- tion keys on both devices match exactly.
Intermittent signal issues.	Signal is too poor.	 Check RSSI. If signal is too low, consider moving devices closer together, clearing ob- stacles in wireless path, or mounting devices higher. Ensure devices are on parallel plane. If communicating over distance of miles, con- sider installing high gain directional antenna.
	Temporary obsta- cles are blocking the wireless path.	 Temporary obstacles, such as large trucks of heavy equipment, can interfere with wireless path. Consider moving wireless units higher or to an area with less traffic.

Symptom	Possible Cause	Corrective Action
Destination device reads out of range, zero, or incorrect.	Wireless device has mismatched input type.	 Make sure that input type on the device is correct for the analog input being used. Op- tions are 4-20 mA, 0-10 V, 0-5 V, or 1-5 V.
999999	Destination de- vice is not scaled properly.	 Destination device must accept 4-20 mA signal and be scaled to properly display the signal. Check the manufacturer's instruction manual for how to do this.
FEEL	Signal connec- tions are improp- erly wired.	Double check to make sure all of the signal connections are properly wired to all devices. Check wiring diagrams starting on page 8.
Digital inputs are not corre- sponding with digital outputs.	Devices have mismatched in- put/output set- tings.	 Check to make sure the digital connection is programmed appropriately as either an input or an output.
ON	Devices are im- properly wired.	 Check to make sure all digital inputs and out- puts are properly wired to all devices. Check wiring diagrams starting on page 8.
Device will not power on.	Not enough volt- age is coming from the power supply.	 Devices require at least 12 VDC each in or- der to power on. Check that the power supply is providing enough voltage to the device and that there are not too many devices drawing power from the supply.
	Devices are improperly wired.	 Check to make sure all power connections are properly wired to all devices. Check wir- ing diagrams starting on page 8.

Symptom	Possible Cause	Corrective Action
Device will not connect to PC via USB	Wireless device is not powered.	 The device must be powered by a 12-28 VDC power supply in order for the PC to recognize it. Power the wireless device and try again.
	Software version is outdated	 Check that you are running the latest soft- ware version. The latest version of PDW Manager can be downloaded at www.predig.com/PDWManager.
	USB cable is faulty	 Try connecting the wireless device using a known good micro USB cable. Any standard USB A to micro USB B cable, such as the one used to charge a smartphone, should work.
Other Issue	If you are experiencing a symptom not listed here, or the suggester troubleshooting steps do not alleviate your problem, please attemp to restore the wireless devices to system defaults by following the instructions on page 20. If you require technical support, please contact us at:	
	Fax: (5 Email:	: (800) 610-5239 or (508) 655-7300 i08) 655-8990 support@predig.com vww.predig.com

Factory Defaults & User Settings

The following table shows the factory setting for most of the programmable parameters on the device. Next to the factory setting, the user may record the new setting for the particular application.


Model:	S/N:	Date:

Primary		
Parameter	Default Setting	User Setting
ANALOG INPUT	4-20mA	
DIGITAL I/O #1	INPUT	
DIGITAL I/O #2	INPUT	
DIGITAL I/O #3	INPUT	
DIGITAL I/O #4	INPUT	
NETWORK ID	01	
MODBUS TIMEOUT	1 SEC	
MODBUS BAUD RATE	9.6K	
DATA FORMAT	8E1	
PASSWORD	0000	

Secondary

Parameter	Default Setting	User Setting
NETWORK ID	01	
ANALOG INPUT	4-20mA	
MODBUS TIMEOUT	0.2 SEC	
PASSWORD	0000	

Mounting Dimensions

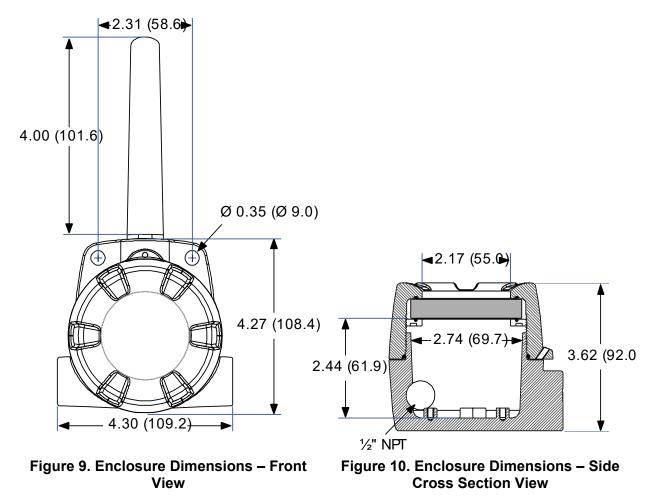

Note: The supplied conduit plug may extend up to 0.6 in [15 mm] from the conduit opening when installed.

PDA6963 Stainless Steel Pipe Mounting Kit

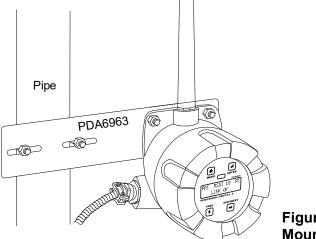


Figure 11. PDA6963 Stainless Steel Pipe Mounting Kit

How to Contact Precision Digital

- For technical support, please: Call: (800) 610-5239 or (508) 655-7300
 Fax: (508) 655-8990
 Email: support@predig.com
- For sales support or to place an order, please contact your local distributor or: Call: (800) 343-1001 or (508) 655-7300 Fax: (508) 655-8990 Email: sales@predig.com
- For the latest version of this manual please visit **www.predig.com**

