


Product information presented here reflects conditions at time of publication. Consult factory regarding discrepancies or inconsistencies.

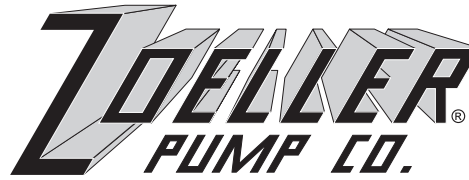


visit our web site:  
www.zoeller.com

MAIL TO: P.O. BOX 16347 • Louisville, KY 40256-0347  
SHIP TO: 3649 Cane Run Road • Louisville, KY 40211-1961  
(502) 778-2731 • 1 (800) 928-PUMP • FAX (502) 774-3624

## SEWAGE SYSTEM SIZING AND SELECTION WORK SHEET

See back side for sizing and selection work sheet. Fill out front side and return to representative or Zoeller Pump Company for system sizing and selection assistance. Complete shaded boxes if sizing of pumps is required. Complete unshaded boxes for system selection.

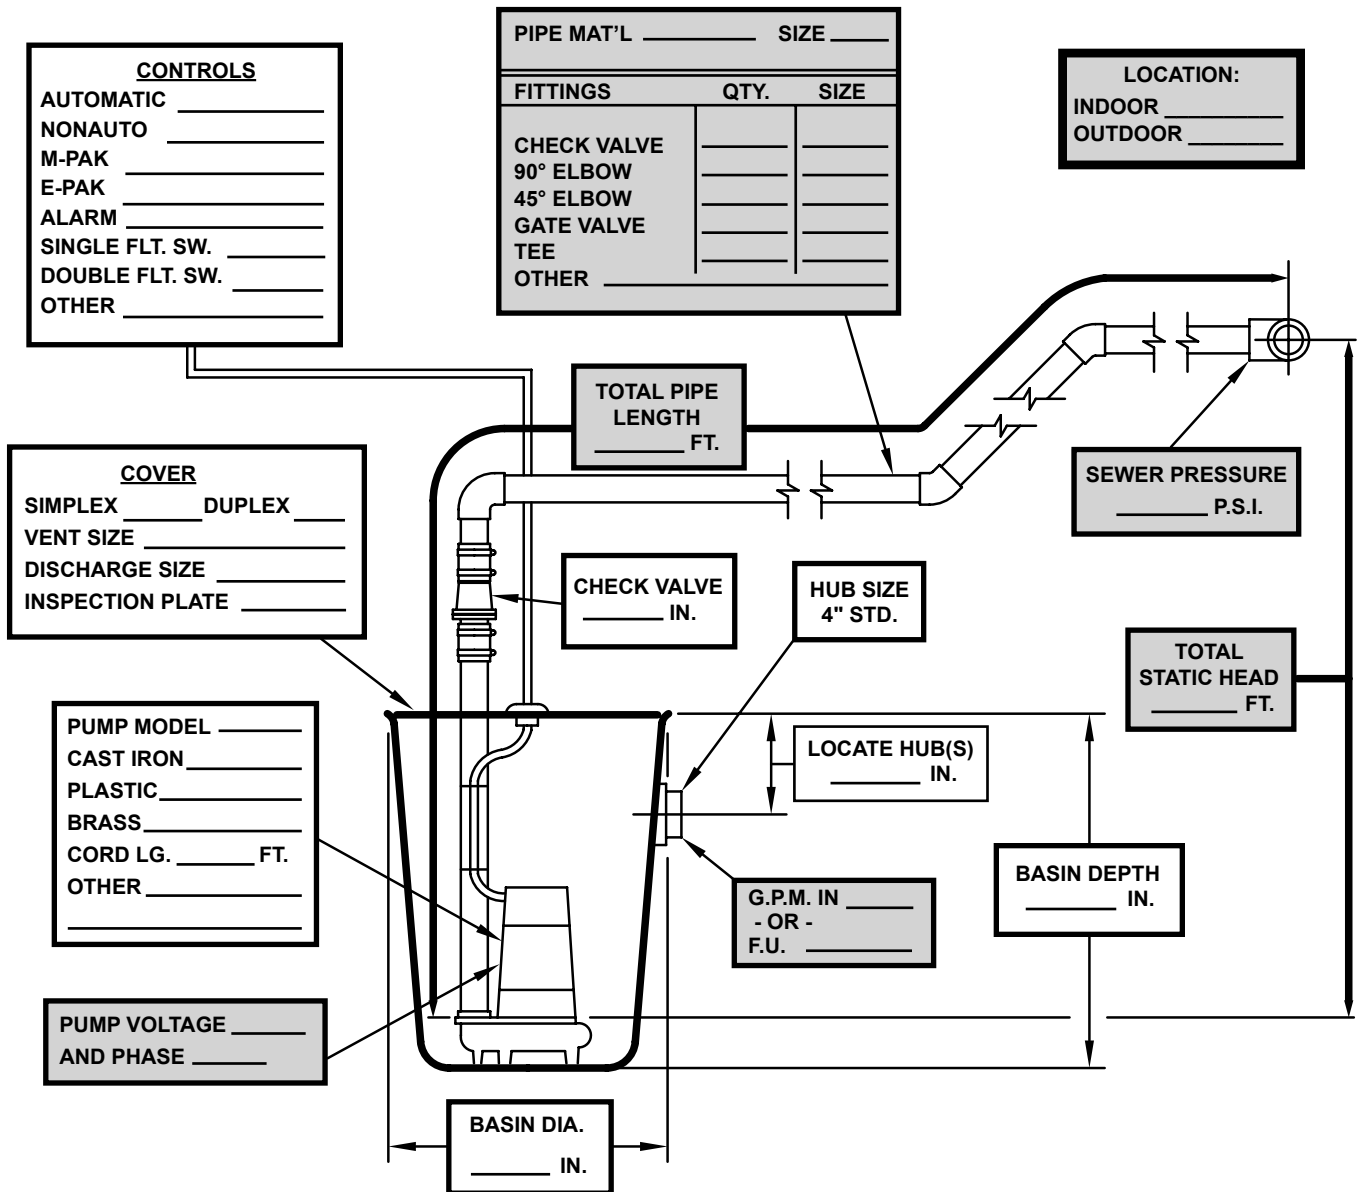

CUSTOMER \_\_\_\_\_  
ADDRESS \_\_\_\_\_  
JOB \_\_\_\_\_  
JOB# \_\_\_\_\_ REP. \_\_\_\_\_  
G.P.M. \_\_\_\_\_ AT T.D.H. OF \_\_\_\_\_

# SEWAGE SYSTEM SIZING AND PUMP SELECTION WORK SHEET

To begin, fill in the shaded areas on the front side. A calculator and additional sheet of paper may be required.

- STEP #1** Determine the type and quantity of each plumbing fixture. Multiply each by its fixture unit values in figure "A". Sum these values \_\_\_\_\_ Determine GPM from figure "B". \_\_\_\_\_ GPM (1)
- STEP #2** Refer to Figure "C". Based on the System's discharge piping size, Determine the minimum GPM Listed for that size. \_\_\_\_\_ GPM (2)
- STEP #3** Select the greater of the two GPM values in #1 & #2. This is your **Design GPM**. If greater than maximum GPM listed in figure, "B", contact factory. \_\_\_\_\_ GPM (3)
- STEP #4** Multiply each pipe fitting by its equivalent length value shown in figure "D" and sum. \_\_\_\_\_ Ft. (4)
- STEP #5** Total pipe length from front side \_\_\_\_\_ Ft. (5)
- STEP #6** Add #4 & #5. [(4) + (5) = (6)] \_\_\_\_\_ Ft. (6)
- STEP #7** Divide #6 by 100 and multiply it by the associated friction value from Figure "E". This is the total Friction Head. \_\_\_\_\_ Ft. (7)
- STEP #8** Determine static head in Ft., as shown on front side, from minimum water level to the discharge point. \_\_\_\_\_ Ft. (8)
- STEP #9** Sewer Pressure, if any, expressed in feet (PSI x 2.31). \_\_\_\_\_ Ft. (9)
- STEP #10** Add #7, #8, & #9. [(7) + (8) + (9) = (10)]. This is the system's **Total Dynamic Head. (TDH)** \_\_\_\_\_ Ft. (10)
- STEP #11** Select the Zoeller Pump:  
Determine solids handling requirement (2" and above). Select pump from curves shown on FM0269 & FM0995. Base selection on design values, [#3 & #10] \_\_\_\_\_ (Model No.)  
Required voltage source \_\_\_\_\_ (Volt/Phase)
- STEP #12** Select type of control:  
 Simplex  Duplex  
If simplex:  
 Mechanical switch  Single float switch  
 Dual float switch  Alarm  
If duplex:  
 Mechanical Alternator  Electrical Alternator
- STEP #13** Select Basin Size: \_\_\_\_\_ in X \_\_\_\_\_ in  
Refer to Figure "F" and FM0541 (Diam.) (Depth)
- STEP #14** Select Basin Cover:  
 One Pump  Dual Pump  
Vent Pipe Size \_\_\_\_\_ in.  
Discharge Pipe Size \_\_\_\_\_ in.

**Final Notes:**


- 1) Consult Factory in any application where TDH is less than 5' #10
- 2) Pump must be capable of providing the minimum required GPM for pipe size, Figure "C", at the calculated TDH #10.
- 3) Pump's lock valve must be greater than system's highest point.

**FIGURE A PLUMBING FIXTURE UNIT VALUES\***

Fixture Description	Fixture Unit Value	Fixture Description	Fixture Unit Value
Bathtub, 1-1/2" trap	2	Sink, service type	3
Bathtub, 2" trap	3	Sink, scullery	4
Bidet, 1-1/2" trap	3	Sink, surgeons	3
Dental unit or cuspidor	1	Swimming pool (per 100 gallons)	1
Drinking fountain	1	Urinal	4**
Dishwasher, domestic	2	Washing machine	2
Kitchen sink	2	Water closet	3**
Kitchen sink with disposal	3	Water softener	4
Lavatory, 1-1/2" trap	1	Unlisted fixture, 1-1/4" trap	2
Lavatory, barber/beautician	2	Unlisted fixture, 1-1/2" trap	3
laundry tray	2	Unlisted fixture, 2" trap	4
Shower	2	Unlisted fixture, 2-1/2" trap	5
Shower, group (per head)	3	Unlisted fixture, 3" trap	6
Bathroom group consisting of lavatory, bathtub or shower, and water closet			6**

\*Graph data is taken from ASPE Handbook, Uniform Plumbing Code, Cameron Hydraulic Data and Plastic Pipe Institute.  
\*\*Add 4 fixture units for each flush valve fixture

**FIGURE B PUMP CAPACITY BASED ON TOTAL FIXTURE UNITS\***

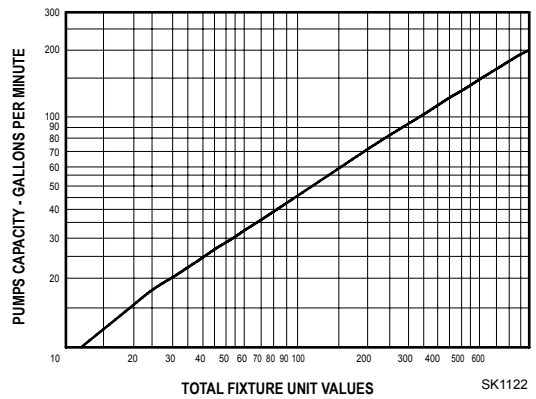

**FIGURE C\***

Pipe Size	Minimum GPM
2"	21
2½"	30
3"	46
4"	78

**FIGURE D\*** Friction factors for pipe fittings in terms of equivalent feet of straight pipe

Nominal Pipe Size	90 Elbow	45 Elbow	Tee (Thru-flow)	Tee Branch flow	Swing Check Valve	Gate Valve
2"	5.2	2.8	3.5	10.3	17.2	1.4
2½"	6.2	3.3	4.1	12.3	20.6	1.7
3"	7.7	4.1	5.1	15.3	25.5	2.0
4"	10.0	5.0	7.0	22.0	33.0	2.3

**FIGURE E\*** FRICTION HEAD IN FEET PER 100' OF SCHEDULE 40 PIPE

GPM	2"		2½"		3"		4"	
	Plastic	Steel	Plastic	Steel	Plastic	Steel	Plastic	Steel
20	0.73	1.55	0.31	0.65				
25	1.10	2.34	0.47	0.99				
30	1.55	3.28	0.65	1.38				
35	2.06	4.37	0.87	1.84	0.30	0.64		
40	2.64	5.59	1.11	2.35	0.39	0.82		
45	3.28	6.95	1.38	2.93	0.48	1.02		
50	3.99	8.45	1.68	3.56	0.58	1.24		
60	5.59	11.8	2.35	4.99	0.82	1.73		
70	7.44	15.8	3.13	6.64	1.09	2.31	0.29	0.70
80	9.52	20.2	4.01	8.50	1.39	2.95	0.37	0.79
90			4.99	10.6	1.73	3.67	0.46	0.98
100			6.06	12.8	2.11	4.47	0.56	1.19
125			9.18	19.5	3.19	6.75	0.85	1.80
150					4.47	9.46	1.19	2.52
175					5.95	12.3	1.58	3.36
200							2.30	4.30
225							2.56	5.35
250							3.07	6.50
300							4.30	9.11

**FIGURE F\*** (Check Fm0541 for Simplex & Duplex Information)

GPM	Recommended BASIN Diameters				
	18"	24"	30"	36"	48"
20					
25					
30					
35					
40					
45					
50					
60					
70					
80					
90					
100					
125					
150					
175					
200					
225					
250					