

Structural I-Beam Pipe Anchors

Load Rated, Pre-Engineered

When pressurized, all bellows type expansion joints exert tremendous anchor loads. Even "hard pipe" expansion loops impose significant loads.

Working with structural engineers and contractors, Metraflex has designed the I-Beam series of pipe anchors to fit almost every application.

The I-Beam series is a Load Rated, Pre-Engineered anchor designed specifically for pipe attachments to the building. The base plate can be welded in place or pre-drilled for bolting.


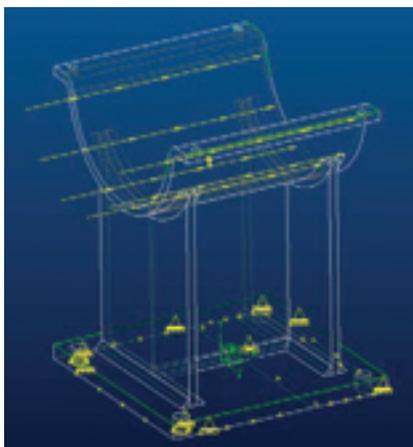


Figure 1

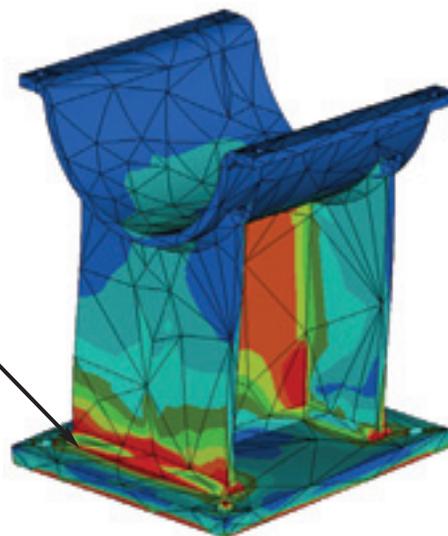

High Stress Point
Figure 2

Design Analysis:

Von Mises stress was used to calculate the safety factor of the anchor with various load requirements. The highest stressed point was the base of the weld at the front edge of the I-Beam. This point is shown in Figure 2.

The Pro/MECHANICA® Finite Element Model (Figure 1) was used to determine the high stress areas on the anchor and calculate the safety factor. The model was constrained along the edges of the base plate to simulate the welding of the anchor to the existing structure. This method of constraint was chosen because of the unknown factors in the bolting of the anchor to different structures. All edges of the base plate were constrained in XYZ translation. The model was meshed with "P" elements, which also included the weld geometry.

Choosing the Right Anchor:

All expansion joint manufacturers can provide you with the effective area of their bellows and its spring rate. Using this formula calculate the anchor load expected, then select the appropriate anchor from the selection on drawing PAI-04.

$$\text{Bellows Thrust Anchor Load} = \frac{\text{Effective Area of Joint}}{\text{Max. System Pressure}^*} + \left(\frac{\text{Spring Rate}}{\text{Actual Movement}} \right)$$

Sample calculation for a 6 inch Metraflex model "Metragator" externally pressurized expansion joint. Maximum pressure of 135 psi* and 3.25 inches of movement. Add to the above weight of pipe, media, insulation and frictional forces.


$$\text{Bellows Thrust Anchor Load} = 58.9 \text{ in}^2 \times 135 \text{ psi}^* + (269 \text{ lbs/in} \times 3.25 \text{ in})$$

8,825.75 lbs**


*Use your systems max test pressure!

**More than your structure can handle? See the Metraloop section of our website.



For complete information, visit us at: www.metraflex.com

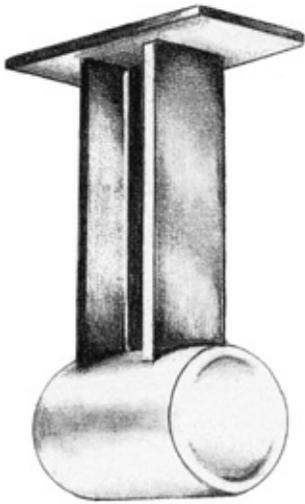

STRUCTURAL I-BEAM ANCHORS



Material Steel
 Finish Painted
 Style W Designed for FIELD WELDING to pipe



| MIN PIPE DIA. | ANCHOR SIZE | I-BEAM SIZE | "L" DIM. & MAX. ANCHOR FORCE (KIPS) | | | | | BASE PLATE DIM | |
|---------------|-------------|-------------|-------------------------------------|--------|--------|--------|--------|----------------|----------------|
| | | | 12" | 18" | 24" | 36" | 48" | DIM A (WIDTH) | DIM B (LENGTH) |
| 2 | PAI-1 | S3X5.7 | 1.397 | 0.951 | 0.732 | 0.497 | 0.371 | 9 | 9 |
| 2.5 | PAI-2 | S4X7.7 | 2.338 | 1.545 | 1.149 | 0.76 | 0.565 | 9 | 10 |
| 3 | PAI-3 | S5X14.75 | 3.211 | 2.15 | 1.617 | 1.08 | 0.812 | 9 | 11 |
| 3 | PAI-4 | S6X12.5 | 4.256 | 2.945 | 2.293 | 1.586 | 1.229 | 10 | 12 |
| 4 | PAI-5 | W8X10 | 5.143 | 3.404 | 2.535 | 1.678 | 1.249 | 12 | 14 |
| 4 | PAI-6 | W12X14 | 10.183 | 7.089 | 5.596 | 3.919 | 3.072 | 10 | 18 |
| 6 | PAI-7 | W6X20 | 7.467 | 4.887 | 3.6 | 2.357 | 1.733 | 14 | 12 |
| 6 | PAI-8 | W8X24 | 13.388 | 9.371 | 7.366 | 5.137 | 4.015 | 14 | 14 |
| 6 | PAI-9 | W12X26 | 18.846 | 13.178 | 10.341 | 7.189 | 5.629 | 12 | 18 |
| 8 | PAI-10 | W14X30 | 24.545 | 16.444 | 12.393 | 8.388 | 6.385 | 13 | 20 |
| 8 | PAI-11 | W16X36 | 30.912 | 21.165 | 16.289 | 11.135 | 8.558 | 13 | 22 |
| 10 | PAI-12 | W10X49 | 31.101 | 22.319 | 17.928 | 12.745 | 10.153 | 16 | 16 |
| 10 | PAI-13 | W12X58 | 42.936 | 30.298 | 23.979 | 16.823 | 13.245 | 16 | 18 |
| 10 | PAI-14 | W14X74 | 52.225 | 36.957 | 29.319 | 20.595 | 16.236 | 16 | 20 |
| 10 | PAI-15 | W16X67 | 62.308 | 41.328 | 30.838 | 20.453 | 15.261 | 16 | 22 |
| 16 | PAI-16 | W14X90 | 63.399 | 53.456 | 37.304 | 23.703 | 16.802 | 20 | 20 |

| Quantity | Length | Pipe Size | Anchor Size | KIPS | Model* No. | Notes |
|----------|--------|-----------|-------------|------|------------|-------|
| | | | | | | |
| | | | | | | |
| | | | | | | |
| | | | | | | |
| | | | | | | |
| | | | | | | |

* Model Numbers = Anchor Size - Style - Length - Pipe Size — i.e. PAI 7 w 36 6

CUSTOMER _____
 PROJECT _____
 ENGINEER _____
 ARCHITECT _____
 PRO. OR P.O. NO _____



DESCRIPTION:

STRUCTURAL I-BEAM ANCHORS

DRAWN BY:
JRR

DATE:
1-8-04

DRAWING NO:
PAI-04A