



Air Conditioning & Heating

GPH14M

COOLING CAPACITY: 24,000 - 58,000 BTU/H

HEATING CAPACITY: 23,000 - 57,500 BTU/H

PACKAGED HEAT PUMPS

2 TO 5 TONS

14 SEER & 8.0 HSPF

Contents

Nomenclature.....	2
Product Specifications.....	3
Expanded Cooling Data.....	4
Expanded Heating Data.....	16
Airflow Data.....	18
Heat Kit Electrical Specs.....	20
Dimensions.....	21
Wiring Diagrams.....	22
Accessories.....	24



Standard Features


- High-efficiency compressor
- ECM indoor blower motor
- Liquid-line filter drier
- Convertible airflow: horizontal or downflow
- All-Aluminum evaporator coil
- Copper tube/aluminum fin condenser coils
- Electric heat kit available as a field-installed option
- AHRI Certified; ETL Listed

Cabinet Features

- Heavy-gauge galvanized-steel cabinet with attractive Architectural Gray powder-paint finish
- Aluminum foil-facing internal insulation reinforced with fiberglass scrim
- Fully insulated air-handling compartment with convenient access panels
- Louvered condenser coil protection
- One footprint; two heights



* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration not required in California or Québec.

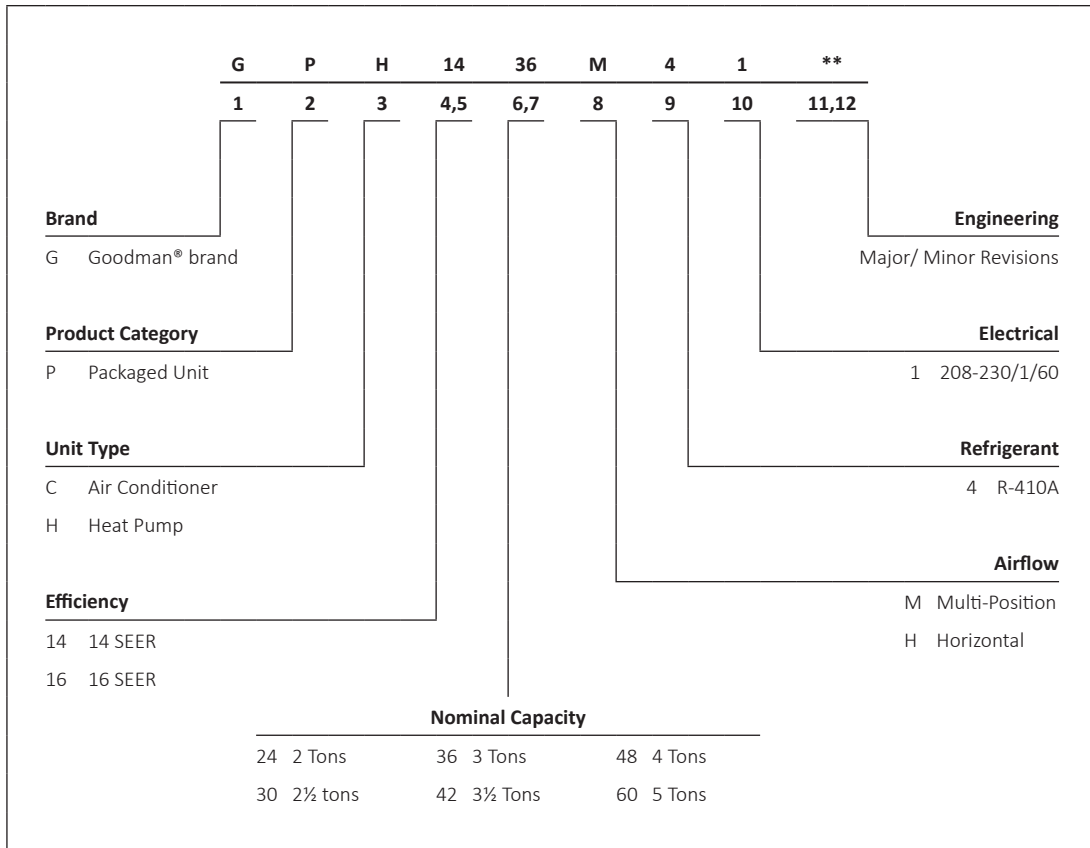

	GPH14 24M41A*	GPH14 30M41A*	GPH14 36M41A*	GPH14 42M41A*	GPH14 48M41A*	GPH14 60M41A*
COOLING CAPACITY						
Total BTU/h	24,000	28,600	34,400	41,000	48,000	58,000
Sensible BTU/h	18,700	21,800	26,200	29,600	36,400	42,500
SEER / EER	14/11	14/11	14/11	14/11	14/11	14/11
Decibels	76	76	81	80	79	80
AHRI #s	7470164	7470160	7470161	7470165	7470166	7470162
HEATING CAPACITY						
BTU/h (47°F)	23,000	28,000	33,200	40,500	45,500	57,000
C.O.P (47°F)	3.6	3.6	3.6	3.6	3.6	3.5
BTU/h (17°F)	12,600	15,000	19,000	22,600	26,600	31,400
C.O.P (17°F)	2.2	2.2	2.2	2.2	2.2	2.2
HSPF	8.0	8.0	8.0	8.0	8.0	8.0
EVAPORATOR MOTOR						
Type	ECM	ECM	ECM	ECM	ECM	ECM
Wheel (D x W)	10 x 9	10 x 9	10 x 9	10 x 9	10 x 9	10 x 9
Nominal Cooling CFM	850	1,050	1,200	1,300	1,600	1,850
FLA / LRA	4.3 / --	4.3 / --	4.3 / --	5.8 / --	5.8 / --	7.6 / --
No. of Speeds	5	5	5	5	5	5
Horsepower - RPM	½ - 1,050	½ - 1,050	½ - 1,050	¾ - 1,050	¾ - 1,050	1 - 1,050
EVAPORATOR COIL						
Face Area (ft²)	4.55	4.55	4.55	4.55	6.20	6.20
Rows Deep/ Fin per Inch	4 / 14	4 / 14	4 / 14	4 / 14	4 / 14	4 / 14
Drain Size (NPT)	¾"	¾"	¾"	¾"	¾"	¾"
R-410A Refrigerant Charge (oz.)	128	128	115	133	153	180
CONDENSER FAN / COIL						
Horsepower - RPM	¼ - 830	¼ - 830	¼ - 830	¼ - 1,075	¼ - 1,075	¼ - 1,075
FLA/LRA	1.5 / 3.0	1.5 / 3.0	1.4 / 3.0	1.4 / 2.9	1.4 / 2.9	2.5 / 3.0
Fan Diameter / # Fan Blades	22 / 3	22 / 3	22 / 4	22 / 3	22 / 3	22 / 3
Face Area (ft²)	12.21	12.21	12.21	12.21	15.30	21.32
Rows Deep/ Fin per Inch	2 / 16	2 / 16	2 / 16	2 / 16	2 / 16	2 / 16
COMPRESSOR						
Quantity	1	1	1	1	1	1
Type	Scroll	Scroll	Scroll	Scroll	Scroll	Scroll
Stage	Single	Single	Single	Single	Single	2 Stage
ELECTRICAL DATA						
Voltage/ Phase (60 Hz)	208-230/1	208-230/1	208-230/1	208-230/1	208-230/1	208-230/1
Compressor RLA/ LRA	12.8 / 58.3	14.1 / 73	16.7 / 79	17.9 / 112	21.8 / 117	27.1 / 152.9
Total Unit Amps	18.6	19.9	22.4	25.1	29	37.2
Min. Circuit Ampacity ¹	21.8	23.4	26.6	29.6	34.5	44.0
Max. Overcurrent Protection ²	30 amps	35 amps	40 amps	45 amps	50 amps	70 amps
SHIPPING WEIGHT (LBS)	380	390	400	410	485	495

¹ Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

² May use fuses or HACR-type circuit breakers of the same size as noted.

Note: Always check the S&R plate for electrical data on the unit being installed.

1	2	3	4	5	6	7	8																																																															
E	D	C	B	A	E	D	C																																																															
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th style="width:10%;">ECN</th> <th style="width:10%;">REV</th> <th style="width:10%;">ZONE</th> <th style="width:10%;">DESCRIPTION</th> <th style="width:10%;">CHK</th> <th style="width:10%;">ID</th> <th style="width:10%;">DATE</th> </tr> <tr> <td>XXXXXX</td> <td>A</td> <td>XXXX</td> <td></td> <td>-</td> <td>GL</td> <td></td> </tr> </table>		ECN	REV	ZONE	DESCRIPTION	CHK	ID	DATE	XXXXXX	A	XXXX		-	GL		<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th rowspan="2" style="width:15%;">MODEL</th> <th colspan="3" style="text-align: center;">DIMENSIONS</th> <th colspan="2" style="text-align: center;">CHASSIS SIZE</th> </tr> <tr> <th style="width:10%;">W"</th> <th style="width:10%;">D"</th> <th style="width:10%;">H"</th> <th style="width:10%;">MED.</th> <th style="width:10%;">LARGE</th> </tr> <tr> <td>GPH1424M41**</td> <td>47</td> <td>51</td> <td>34$\frac{3}{4}$</td> <td>X</td> <td></td> </tr> <tr> <td>GPH1430M41**</td> <td>47</td> <td>51</td> <td>34$\frac{3}{4}$</td> <td>X</td> <td></td> </tr> <tr> <td>GPH1436M41**</td> <td>47</td> <td>51</td> <td>34$\frac{3}{4}$</td> <td>X</td> <td></td> </tr> <tr> <td>GPH1442M41**</td> <td>47</td> <td>51</td> <td>34$\frac{3}{4}$</td> <td>X</td> <td></td> </tr> <tr> <td>GPH1448M41**</td> <td>47</td> <td>51</td> <td>42$\frac{3}{4}$</td> <td></td> <td>X</td> </tr> <tr> <td>GPH1460M41**</td> <td>47</td> <td>51</td> <td>42$\frac{3}{4}$</td> <td></td> <td>X</td> </tr> </table>		MODEL	DIMENSIONS			CHASSIS SIZE		W"	D"	H"	MED.	LARGE	GPH1424M41**	47	51	34 $\frac{3}{4}$	X		GPH1430M41**	47	51	34 $\frac{3}{4}$	X		GPH1436M41**	47	51	34 $\frac{3}{4}$	X		GPH1442M41**	47	51	34 $\frac{3}{4}$	X		GPH1448M41**	47	51	42 $\frac{3}{4}$		X	GPH1460M41**	47	51	42 $\frac{3}{4}$		X					<p style="text-align: center;">Goodman Company, L.C.</p> <p style="text-align: center;">GPH14M</p> <p style="text-align: center;">DOWN BY: _____ ENG: _____</p> <p style="text-align: center;">DIMENSIONS TO BE INTERPRETED IN ACCORDANCE WITH ASHRAE 14.1.00</p> <p style="text-align: center;">DIMENSIONS ARE IN INCHES</p> <p style="text-align: center;">TOLERANCES:</p> <p style="text-align: center;">X: .1</p> <p style="text-align: center;">XXX: .015</p> <p style="text-align: center;">HOLES: .1 .005</p> <p style="text-align: center;">TUBES CUT TO: .003</p> <p style="text-align: center;">DO NOT SCALE DRAWING</p> <p style="text-align: center;">SHEET 1 OF 1</p> <p style="text-align: center;">REV _____</p> <p style="text-align: center;">A</p>	
ECN	REV	ZONE	DESCRIPTION	CHK	ID	DATE																																																																
XXXXXX	A	XXXX		-	GL																																																																	
MODEL	DIMENSIONS			CHASSIS SIZE																																																																		
	W"	D"	H"	MED.	LARGE																																																																	
GPH1424M41**	47	51	34 $\frac{3}{4}$	X																																																																		
GPH1430M41**	47	51	34 $\frac{3}{4}$	X																																																																		
GPH1436M41**	47	51	34 $\frac{3}{4}$	X																																																																		
GPH1442M41**	47	51	34 $\frac{3}{4}$	X																																																																		
GPH1448M41**	47	51	42 $\frac{3}{4}$		X																																																																	
GPH1460M41**	47	51	42 $\frac{3}{4}$		X																																																																	
<p style="text-align: center;">COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 824.01 WORKMANSHIP STANDARD FOR FIT, FEEL AND FINISH.</p> <p style="text-align: center;">CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY. I.P. NOT TO BE ENCLOSED TO OTHERS, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.</p>					<p style="text-align: center;">SPECIAL CHARACTERISTICS:</p> <p>⊕ = 6SIGMA ⊕ = CRITICAL CHARACTERISTIC ⊕ = SIGNIFICANT CHARACTERISTIC</p>		<p style="text-align: center;">1</p>																																																															